

BEFORE THE ARIZONA POWER PLANT AND
TRANSMISSION LINE SITING COMMITTEE

IN THE MATTER OF THE APPLICATION)
OF ARIZONA PUBLIC SERVICE)
COMPANY IN CONFORMANCE WITH)
THE REQUIREMENTS OF ARIZONA)
REVISED STATUTES SECTION 40-360,)
et seq., FOR A CERTIFICATE OF)
ENVIRONMENTAL COMPATIBILITY)
AUTHORIZING THE TS-9 TO PINNACLE)
PEAK 500kV/230kV TRANSMISSION LINE)
PROJECT WHICH INCLUDES A 500kV)
TRANSMISSION LINE, A 230kV)
TRANSMISSION LINE AND)
ASSOCIATED FACILITIES AND INTER-)
CONNECTIONS ORIGINATING FROM)
THE PROPOSED TS-9 SUBSTATION)
LOCATED SOUTH OF SR74 IN PEORIA,)
AT SECTION 33, TOWNSHIP 6 NORTH,)
RANGE 1 EAST, G&SRB&M, TO THE)
EXISTING PINNACLE PEAK)
SUBSTATION LOCATED NEAR 64TH)
STREET AND PINNACLE PEAK ROAD)
IN PHOENIX, AT SECTION 10,)
TOWNSHIP 4 NORTH, RANGE 4 EAST,)
G&SRB&M.)

Docket No. L-00000D-06-0635-0131

Case No. 131

AZ CORP COMMISSION
DOCUMENT CONTROL

2006 NOV 14 P 4:40

RECEIVED

NOTICE OF FILING AFFIDAVITS OF PUBLICATION

Arizona Public Service Company submits the attached Affidavits of Publication of the Notice of Hearing in the above-captioned docket. The Notice of Hearing was published in the following newspapers on the corresponding dates:

Arizona Corporation Commission

DOCKETED

NOV 14 2006

The Arizona Republic
Anthem/Deer Valley Independent

October 11, 2006
October 11, 2006

DOCKETED BY
nr

1 C. Webb Crockett
2 Patrick Black
3 Fennemore Craig
4 3003 N. Central Avenue
5 Suite 2600
6 Phoenix, Arizona 85012

7 William E. Lally
8 Withey Anderson & Morris, P.L.C.
9 2525 E. Arizona Biltmore circle
10 Suite A-212
11 Phoenix, Arizona 85016

12 
13
14
15
16
17
18
19
20
21
22
23
24
25
26

STATE OF ARIZONA }
COUNTY OF MARICOPA } ss.

David N Linehan , being first duly sworn,
upon oath deposes and says:

That he is the agent of Phoenix Newspapers Inc., publishers of

**The Arizona Republic
Arizona Business Gazette**


a newspaper of general circulation in the County of Maricopa, State
of Arizona, published at Phoenix, Arizona, and that the copy hereto
attached is a true copy of the advertisement published in the said paper

for a period of { 1 day } as follows:

Arizona Public Service
Media Buying Services

A1475228
10/11/06
5x21.5 column inches
News (Sect A & B)

11/02/06

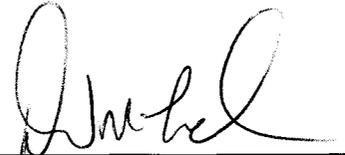


Agent

Subscribed and sworn to before me this 2nd day of November,

A. D. 2006

My Commission Expires

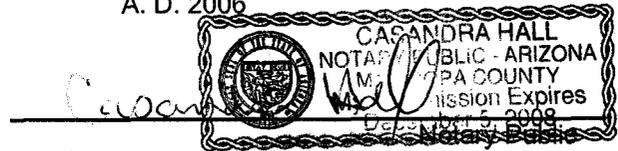

BEFORE THE ARIZONA POWER PLANT AND TRANSMISSION LINE SITING COMMITTEE

The Application also sets forth four Proposed Alternative Alignments as described below:

- **ALTERNATIVE ALIGNMENT #1** - Originates south of the CAP Canal on the west side of Interstate 17 crossing I-17 to the east and proceeding south paralleling the east side of I-17 to the north side of Skunk Creek. Parallels the north side of Skunk Creek crossing I-17 to the west and terminating on the west side of I-17 just north of Skunk Creek.
- **ALTERNATIVE ALIGNMENT #2** - Originates south of the CAP Canal on the west side of Interstate 17 crossing I-17 to the east then roughly following the western embankment of Skunk Creek to a point just east of I-17 and north of Skunk Creek. Parallels the north side of Skunk Creek crossing I-17 to the west terminating on the west side of I-17 just north of Skunk Creek.
- **ALTERNATIVE ALIGNMENT #3** - Originates on the west side of Interstate 17 just north of Skunk Creek. Crosses I-17 to the east then proceeds south paralleling the east side of I-17 to Jomax Road. Turns east following the south side of Jomax Road to 19th Avenue. Turns south following the west side of 19th Avenue to the existing WW-PP Corridor approximately ¼ mile south of Happy Valley Road. Terminates on the north side of the existing power line corridor at 19th Avenue.

- **ALTERNATIVE ALIGNMENT #4** - Originates at a point approximately 1/4 mile south of Happy Valley Road at the 29th Avenue alignment. Parallels 29th Avenue south to Pinnacle Peak Road. Turns east paralleling Pinnacle Peak Road to Interstate 17. Follows the west side of I-17 south to a point just south of the Pinnacle Peak Road Alignment where it crosses I-17 to the east to 23rd Avenue. Follows the south side of Corporate Way southwest from 23rd Avenue to 19th Avenue. Follows 19th Avenue north to Pinnacle Peak Road. Follows Pinnacle Peak Road east to Central Avenue turning north on Central Avenue to the future Misty Willow Substation located in Section 8, Township 4 North, Range 3 East. Continues north on Central Avenue to the existing WW-PP Corridor located approximately ¼ mile south of Happy Valley Road terminating on the north side of an existing 230kV power line.

A general location map of the Project study area, Applicant's Proposed Route and references to the corridors described above is set forth below.

More complete maps, along with more detailed textual descriptions of the proposed and alternative alignments are available in the Application itself and on the Project website. The Application, including detailed maps of the proposed Project, is on file with the Docket Control Center of the Arizona Corporation Commission, 1200 West Washington Street, Suite 108, Phoenix, Arizona 85007.

Depending on the issues raised and the number of interveners appearing during the hearing, the Committee may deem it appropriate at some point to recess the hearing to a time and place to be announced during the hearing, or to be determined after the recess. These dates and places will be posted on the Project and

Docket No. L-00000D-06-0635-0131, Case No. 131

IN THE MATTER OF THE APPLICATION OF ARIZONA PUBLIC SERVICE COMPANY IN CONFORMANCE WITH THE REQUIREMENTS OF ARIZONA REVISED STATUTES SECTION 40-360, ET SEQ., FOR A CERTIFICATE OF ENVIRONMENTAL COMPATIBILITY AUTHORIZING THE TS-9 TO PINNACLE PEAK 500KV/230KV TRANSMISSION LINE PROJECT WHICH INCLUDES A 500KV TRANSMISSION LINE, A 230KV TRANSMISSION LINE AND ASSOCIATED FACILITIES AND INTERCONNECTIONS ORIGINATING FROM THE PROPOSED TS-9 SUBSTATION LOCATED SOUTH OF SKY 4 IN PEORIA, AT SECTION 33, TOWNSHIP 6 NORTH, RANGE 1 EAST, G&SRB&M, TO THE EXISTING PINNACLE PEAK SUBSTATION LOCATED NEAR 64TH STREET AND PINNACLE PEAK ROAD IN PHOENIX, AT SECTION 10, TOWNSHIP 4 NORTH, RANGE 4 EAST, G&SRB&M.

NOTICE OF HEARING

A PUBLIC HEARING WILL BE HELD before the Arizona Power Plant and Transmission Line Siting Committee ("Committee") regarding the Application of Arizona Public Service Company ("APS") for a Certificate of Environmental Compatibility authorizing the TS-9 to Pinnacle Peak 500kV/230kV Transmission Line Project ("Project") in Maricopa County, Arizona. The hearing will be held at the Sheraton Crescent Hotel 2620 West Dunlap Avenue, Phoenix, Arizona 85021 on November 27, 2006 at 9:30 a.m. and continuing on November 28, December 11, and December 12, 2006 at 9:30 a.m. The hearings will adjourn at approximately 5:00 p.m. Additional hearing days, if required, will be noticed on the Project and Arizona Corporation Commission ("ACC") websites. The Project website is <http://siting.aps.com>. The ACC website is www.cc.state.az.us/utility/electric/linesiting-calendar.htm.

Public comment will be taken at the beginning of each hearing day. Public comment also will be taken in a special evening session on November 27, 2006 beginning at 6:30 p.m. at the Sheraton Crescent Hotel 2620 West Dunlap Avenue, Phoenix, Arizona 85021.

The Committee may conduct a tour of the Project area, proposed route and proposed alternative routes on a future date. The map and itinerary for the tour will be available at the hearings and posted on the Project website. Members of the public may follow the Committee in their own private vehicles. During any tour, the Committee will not discuss or deliberate in any manner concerning the Application.

The Project consists of approximately 27 miles of 500kV/230kV transmission lines and two new substations: the TS-9 substation and an expansion of the existing Pinnacle Peak substation.

The proposed route and requested corridor width is described as follows:

- The proposed route is similar to the route that was approved in Case L-00000D-02-0120 (North Valley 230kV Facility Siting Project). A copy of the

- Originating at the proposed TS-9 Substation in Section 33, Township 6 North, Range 1 East parallel to the existing Navajo 500kV Transmission Line Corridor ("Navajo Corridor") following the Navajo Corridor southwest to the Dove Valley Road alignment in a 1,500 foot wide corridor measured to the east from the westernmost edge of the existing Navajo Corridor right-of-way.
- Turns east and follows the Dove Valley Road alignment east to the 39th Avenue alignment adjacent to the future Avery Substation, approved in Case L-00000D-02-0120, located in Section 15, Township 6 North, Range 2 East in a 3,000 foot corridor (1,500 feet north and 1,500 feet south) centered on the section line designating the Dove Valley Road alignment.
- Turns south following the 39th Avenue alignment south for one mile to the Lone Mountain Road alignment in a 2,000 foot wide corridor (1,000 feet east and 1,000 feet west) centered on the mid-section line designating 39th Avenue.
- Turns southeast crossing Sections 22 and 23, Township 5 North, Range 2 East on a southeasterly diagonal to meet Interstate 17 at a point designated as Latitude 33.7, Longitude -112.13 in a 2,000 foot corridor (1,000 feet each side) centered on the alignment between the intersection of 39th Avenue and Lone Mountain Road and Lat. 33.7, Long. -112.13.

- Follows the west side of Interstate 17 south to Oberlin Way in a 500 foot corridor west of the existing Arizona Department of Transportation (ADOT) Right-of-Way.

- Continues south along the west side of Interstate 17 from Oberlin Way to the existing Westwing to Pinnacle Peak 230kV power line corridor ("WW-PP Corridor") located approximately ¼ mile south of Happy Valley Road in a 1,000 foot corridor west of the existing ADOT Right-of-Way.
- Turns east within the existing WW-PP Corridor along the north side of an existing 230kV power line to Central Avenue in a 175 foot corridor north of the centerline of the existing 230kV structures.
- At Central Avenue the 230kV circuit turns south to form an in and out inter-connection with the Misty Willow Substation, approved in Case L-00000D-02-0120, located in Section 8, Township 4 North, Range 3 East in a 1,000 foot corridor (500 feet east and 500 feet west) along the centerline of Central Avenue.
- Both circuits (500kV/230kV) continue east within the existing WW-PP Corridor along the north side of an existing 230kV power line to 56th Street in a 175 foot corridor north of the existing 230kV structures.
- Continues east within the existing WW-PP Corridor along the north side of an existing 230kV power line to its termination at the Pinnacle Peak Substation located in Section 10, Township 4 North, Range 4 East in a 1,500 foot corridor north of the centerline of the existing SRP 230kV structures.

meant to be announced during the hearing, or to be determined after the recess. These dates and places will be posted on the Project and ACC websites. At the discretion of the Committee, such resumed hearing may be held at a date, time and place designated by the Committee or its Chairman.

NOTE: NOTICE OF SUCH RESUMED HEARING WILL BE GIVEN. PUBLISHED NOTICE OF SUCH RESUMED HEARING IS NOT REQUIRED.

Each county and municipal government and state agency interested in the proposed Project and desiring to become a party to the proceeding, shall, not less than ten (10) days before the date set for hearing, file with the Director of Utilities, Arizona Corporation Commission, 1200 West Washington, Phoenix, Arizona, 85007, a notice of its intent to be a party.

Any domestic, non-profit corporation or association, formed in whole or in part to promote conservation of natural beauty, to protect the environment, personal health or other biological values, to preserve historical sites, to promote consumer interests, to represent commercial and industrial groups or to promote the orderly development of the area in which the Project is to be located and desiring to become a party to the certification proceeding, shall, not less than ten (10) days before the date set for hearing, file with the Director of Utilities, Arizona Corporation Commission, 1200 West Washington, Phoenix, Arizona 85007, a notice of its intent to be a party.

The Committee or its Chairman, at any time deemed appropriate, may make other persons parties to the proceedings.

Any person may make a limited appearance at the hearing by filing a statement in writing with the Director of Utilities, Arizona Corporation Commission, 1200 West Washington, Phoenix, Arizona 85007, not less than five (5) days before the date set for hearing. A person making a limited appearance shall not be a party or have the right to present testimony or cross-examine witnesses.

This proceeding is governed by Arizona Revised Statutes Sections 40-360 to 40-360.13 and Arizona Administrative Code Rules R14-3-201 to R14-3-219. The applicable Arizona Revised Statutes can be obtained online at www.azleg.state.az.us/ArizonaRevisedStatutes.asp?Title=40. The applicable Arizona Administrative Codes can be obtained at www.azsos.gov/public_services/Title_14/14-03.htm

The written decision of the Committee shall be submitted to the Arizona Corporation Commission pursuant to Arizona Revised Statutes Section 40-360.07. Any person intending to be a party before the Arizona Corporation Commission must be a party to the certification proceedings before the Committee.

ORDERED this 10th day of October, 2006.

/s/ Laurie A. Woodall
 Assistant Attorney General
 Chairman, Arizona Power Plant and
 Transmission Line Siting Committee

AFFIDAVIT FOR PUBLICATION

Before me, a Notary Public in and for the County of Pinal, State of Arizona, this the 19th day of October, 2006 appeared Twyla Knudson, who being duly sworn says that she is an advertising Sales Consultant of the Independent, a Weekly Newspaper of general circulation, published in Anthem/Deer Valley, County of Maricopa, State of Arizona, and that the attached is a true and complete copy, published in said Newspaper beginning October 11, 2006 and published on the following dates:


(X) No other date

Signed

Twyla Knudson
Twyla Knudson, Advertising Consultant

Subscribed and sworn before me this 19th day of October, 2006

Tina Pendexter
NOTARY PUBLIC

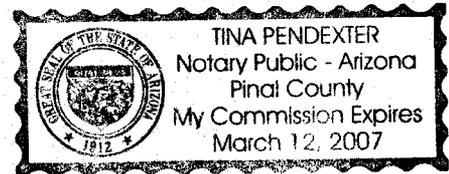

My Commission Expires March 12, 2007

BEFORE THE ARIZONA POWER PLANT AND TRANSMISSION LINE SITING COMMITTEE

Docket No. L-00000D-06-0635-0131, Case No. 131

IN THE MATTER OF THE APPLICATION OF ARIZONA PUBLIC SERVICE COMPANY IN CONFORMANCE WITH THE REQUIREMENTS OF ARIZONA REVISED STATUTES SECTION 40-360, ET SEQ., FOR A CERTIFICATE OF ENVIRONMENTAL COMPATIBILITY AUTHORIZING THE TS-9 TO PINNACLE PEAK 500KV/230KV TRANSMISSION LINE PROJECT WHICH INCLUDES A 500KV TRANSMISSION LINE, A 230KV TRANSMISSION LINE AND ASSOCIATED FACILITIES AND INTERCONNECTIONS ORIGINATING FROM THE PROPOSED TS-9 SUBSTATION LOCATED SOUTH OF SR74 IN PEORIA, AT SECTION 33, TOWNSHIP 6 NORTH, RANGE 1 EAST, G&SRB&M, TO THE EXISTING PINNACLE PEAK SUBSTATION LOCATED NEAR 64TH STREET AND PINNACLE PEAK ROAD IN PHOENIX, AT SECTION 10, TOWNSHIP 4 NORTH, RANGE 4 EAST, G&SRB&M.

NOTICE OF HEARING

A PUBLIC HEARING WILL BE HELD before the Arizona Power Plant and Transmission Line Siting Committee ("Committee") regarding the Application of Arizona Public Service Company ("APS") for a Certificate of Environmental Compatibility authorizing the TS-9 to Pinnacle Peak 500KV/230KV Transmission Line Project ("Project") in Maricopa County, Arizona. The hearing will be held at the Sheraton Crescent Hotel 2620 West Dunlap Avenue, Phoenix, Arizona 85021 on November 27, 2006 at 9:30 a.m. and continuing on November 28, December 11, and December 12, 2006 at 9:30 a.m. The hearings will adjourn at approximately 5:00 p.m. Additional hearing days, if required, will be noticed on the Project and Arizona Corporation Commission ("ACC") websites. The Project website is <http://siting.aps.com>. The ACC website is www.cc.state.az.us/utility/electric/linesiting-calendar.htm.

Public comment will be taken at the beginning of each hearing day. Public comment also will be taken in a special evening session on November 27, 2006 beginning at 6:30 p.m. at the Sheraton Crescent Hotel 2620 West Dunlap Avenue, Phoenix, Arizona 85021.

The Committee may conduct a tour of the Project area, proposed route and proposed alternative routes on a future date. The map and itinerary for the tour will be available at the hearings and posted on the Project website. Members of the public may follow the Committee in their own private vehicles. During any tour, the Committee will not discuss or deliberate in any manner concerning the Application.

The Project consists of approximately 27 miles of 500KV/230KV transmission lines and two new substations: the TS-9 substation and an expansion of the existing Pinnacle Peak substation.

The Application also sets forth four Proposed Alternative Alignments as described below:

- **ALTERNATIVE ALIGNMENT #1** - Originates south of the CAP Canal on the west side of Interstate 17 crossing I-17 to the east and proceeding south paralleling the east side of I-17 to the north side of Skunk Creek. Parallels the north side of Skunk Creek crossing I-17 to the west and terminating on the west side of I-17 just north of Skunk Creek.
- **ALTERNATIVE ALIGNMENT #2** - Originates south of the CAP Canal on the west side of Interstate 17 crossing I-17 to the east then roughly following the western embankment of Skunk Creek to a point just east of I-17 and north of Skunk Creek. Parallels the north side of Skunk Creek crossing I-17 to the west terminating on the west side of I-17 just north of Skunk Creek.
- **ALTERNATIVE ALIGNMENT #3** - Originates on the west side of Interstate 17 just north of Skunk Creek. Crosses I-17 to the east then proceeds south paralleling the east side of I-17 to Jomax Road. Turns east following the south side of Jomax Road to 19th Avenue. Turns south following the west side of 19th Avenue to the existing WW-PP Corridor approximately ¼ mile south of Happy Valley Road. Terminates on the north side of the existing power line corridor at 19th Avenue.
- **ALTERNATIVE ALIGNMENT #4** - Originates at a point approximately 1/4 mile south of Happy Valley Road at the 29th Avenue alignment. Parallels 29th Avenue south to Pinnacle Peak Road. Turns east paralleling Pinnacle Peak Road to Interstate 17. Follows the west side of I-17 south to a point just south of the Pinnacle Peak Road Alignment where it crosses I-17 to the east to 23rd Avenue. Follows the south side of Corporate Way southwest from 23rd Avenue to 19th Avenue. Follows 19th Avenue north to Pinnacle Peak Road. Follows Pinnacle Peak Road east to Central Avenue turning north on Central Avenue to the future Misty Willow Substation located in Section 8, Township 4 North, Range 3 East. Continues north on Central Avenue to the existing WW-PP Corridor located approximately ¼ mile south of Happy Valley Road terminating on the north side of an existing 230KV power line.

A general location map of the Project study area, Applicant's Proposed Route and references to the corridors described above is set forth below.

More complete maps, along with more detailed textual descriptions of the proposed and alternative alignments are available in the Application itself and on the Project website. The Application, including detailed maps of the proposed Project, is on file with the Docket Control Center of the Arizona Corporation Commission, 1200 West Washington Street, Suite 108, Phoenix, Arizona 85007.

The proposed route and requested corridor width is described as follows:

- The proposed route is similar to the route that was approved in Case L-00000D-02-0120 (North Valley 230kV Facility Siting Project). A copy of the approved order can be obtained at: http://www.azps.com/aps/general_info/siting/siting_22.html
- Originating at the proposed TS-9 Substation in Section 33, Township 6 North, Range 1 East parallel to the existing Navajo 500kV Transmission Line Corridor ("Navajo Corridor") following the Navajo Corridor southwest to the Dove Valley Road alignment in a 1,500 foot wide corridor measured to the east from the westernmost edge of the existing Navajo Corridor right-of-way.
- Turns east and follows the Dove Valley Road alignment east to the 39th Avenue alignment adjacent to the future Avery Substation, approved in Case L-00000D-02-0120, located in Section 15, Township 6 North, Range 2 East in a 3,000 foot corridor (1,500 feet north and 1,500 feet south) centered on the section line designating the Dove Valley Road alignment.
- Turns south following the 39th Avenue alignment south for one mile to the Lone Mountain Road alignment in a 2,000 foot wide corridor (1,000 feet east and 1,000 feet west) centered on the mid-section line designating 39th Avenue.
- Turns southeast crossing Sections 22 and 23, Township 5 North, Range 2 East on a southeasterly diagonal to meet Interstate 17 at a point designated as Latitude 33.7, Longitude -112.13 in a 2,000 foot corridor (1,000 feet each side) centered on the alignment between the intersection of 39th Avenue and Lone Mountain Road and Lat. 33.7, Long. -112.13.
- Follows the west side of Interstate 17 south to Oberlin Way in a 500 foot corridor west of the existing Arizona Department of Transportation (ADOT) Right-of-Way.
- Continues south along the west side of Interstate 17 from Oberlin Way to the existing Westwing to Pinnacle Peak 230kV power line corridor ("WW-PP Corridor") located approximately ¼ mile south of Happy Valley Road in a 1,000 foot corridor west of the existing ADOT Right-of-Way.
- Turns east within the existing WW-PP Corridor along the north side of an existing 230kV power line to Central Avenue in a 175 foot corridor north of the centerline of the existing 230kV structures.
- At Central Avenue the 230kV circuit turns south to form an in and out interconnection with the Misty Willow Substation, approved in Case L-00000D-02-0120, located in Section 8, Township 4 North, Range 3 East in a 1,000 foot corridor (500 feet east and 500 feet west) along the centerline of Central Avenue.
- Both circuits (500kV/230kV) continue east within the existing WW-PP Corridor along the north side of an existing 230kV power line to 56th Street in a 175 foot corridor north of the existing 230kV structures.
- Continues east within the existing WW-PP Corridor along the north side of an existing 230kV power line to its termination at the Pinnacle Peak Substation located in Section 10, Township 4 North, Range 4 East in a 1,500 foot corridor north of the centerline of the existing SRP 230kV structures.

Depending on the issues raised and the number of interveners appearing during the hearing, the Committee may deem it appropriate at some point to recess the hearing to a time and place to be announced during the hearing, or to be determined after the recess. These dates and places will be posted on the Project and ACC websites. At the discretion of the Committee, such resumed hearing may be held at a date, time and place designated by the Committee or its Chairman.

NOTE: NOTICE OF SUCH RESUMED HEARING WILL BE GIVEN. PUBLISHED NOTICE OF SUCH RESUMED HEARING IS NOT REQUIRED.

Each county and municipal government and state agency interested in the proposed Project and desiring to become a party to the proceeding, shall, not less than ten (10) days before the date set for hearing, file with the Director of Utilities, Arizona Corporation Commission, 1200 West Washington, Phoenix, Arizona, 85007, a notice of its intent to be a party.

Any domestic, non-profit corporation or association, formed in whole or in part to promote conservation of natural beauty, to protect the environment, personal health or other biological values, to preserve historical sites, to promote consumer interests, to represent commercial and industrial groups or to promote the orderly development of the area in which the Project is to be located and desiring to become a party to the certification proceeding, shall, not less than ten (10) days before the date set for hearing, file with the Director of Utilities, Arizona Corporation Commission, 1200 West Washington, Phoenix, Arizona 85007, a notice of its intent to be a party.

The Committee or its Chairman, at any time deemed appropriate, may make other persons parties to the proceedings.


Any person may make a limited appearance at the hearing by filing a statement in writing with the Director of Utilities, Arizona Corporation Commission, 1200 West Washington, Phoenix, Arizona 85007, not less than five (5) days before the date set for hearing. A person making a limited appearance shall not be a party or have the right to present testimony or cross-examine witnesses.

This proceeding is governed by Arizona Revised Statutes Sections 40-360 to 40-360.13 and Arizona Administrative Code Rules R14-3-201 to R14-3-219. The applicable Arizona Revised Statutes can be obtained online at www.azleg.state.az.us/ArizonaRevisedStatutes.asp?Title=40. The applicable Arizona Administrative Codes can be obtained at www.azsos.gov/public_services/Title_14/14-03.htm

The written decision of the Committee shall be submitted to the Arizona Corporation Commission pursuant to Arizona Revised Statutes Section 40-360.07. Any person intending to be a party before the Arizona Corporation Commission must be a party to the certification proceedings before the Committee.

ORDERED this 10th day of October, 2006.

/s/ Laurie A. Woodall
Assistant Attorney General
Chairman, Arizona Power Plant and
Transmission Line Siting Committee

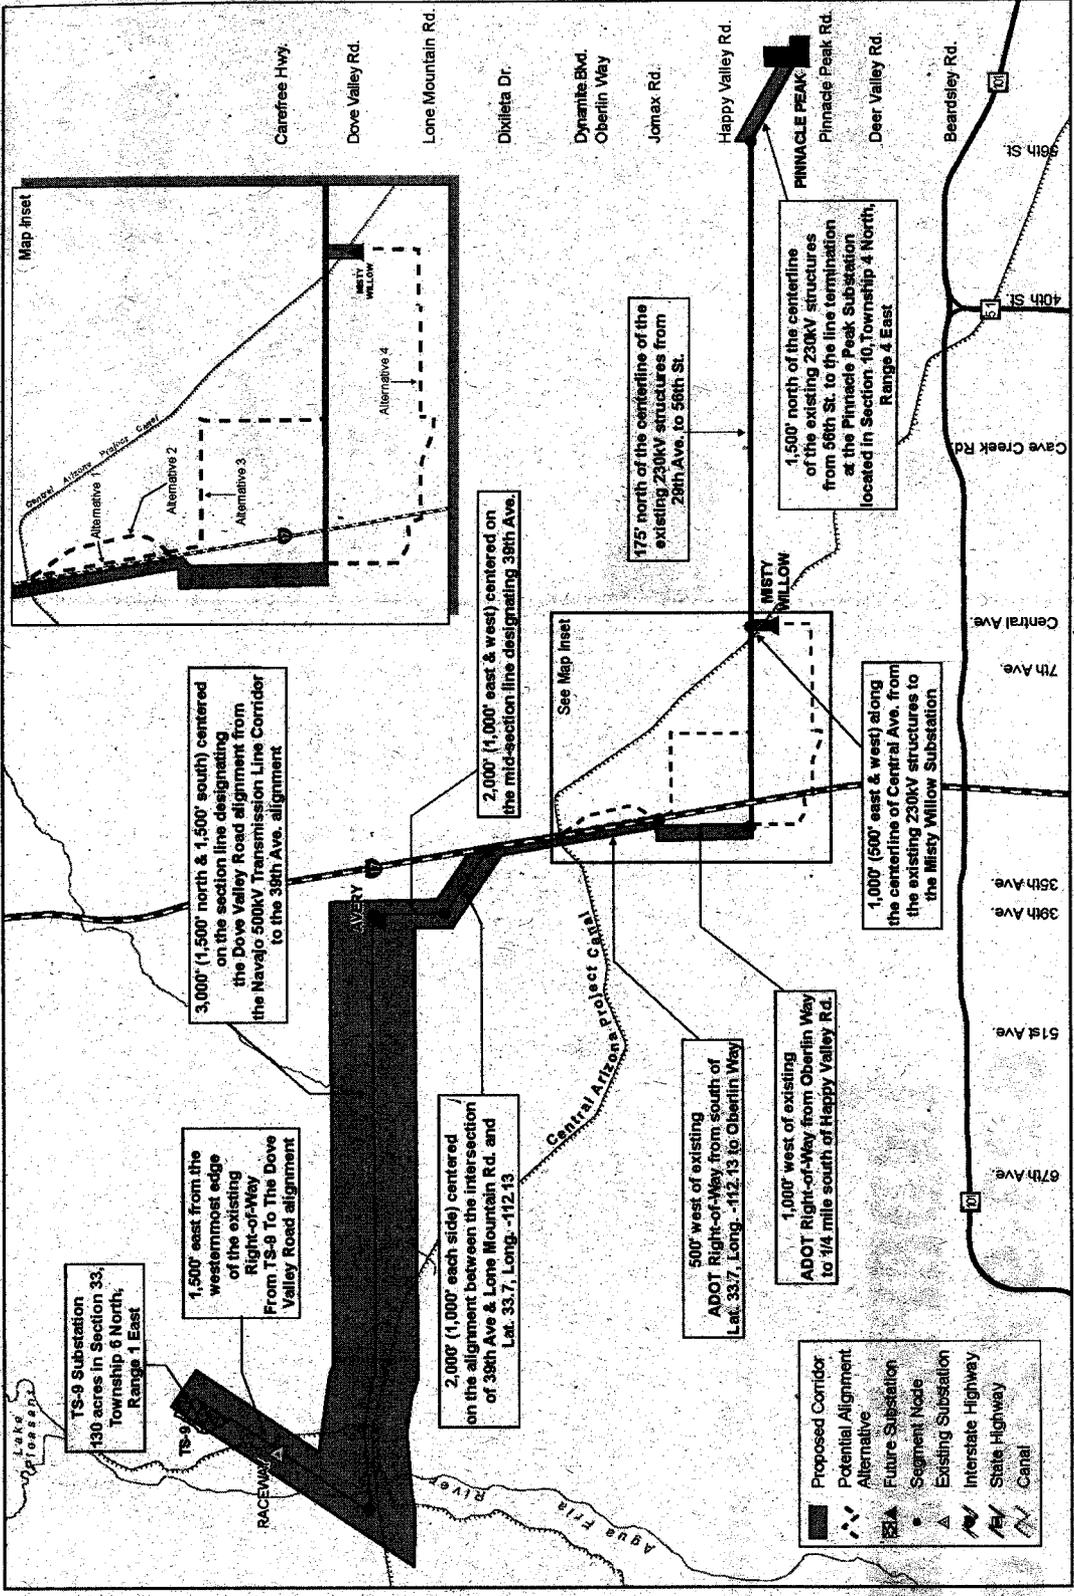

TS-9 Substation
130 acres in Section 33,
Township 6 North,
Range 1 East

1,500' east from the
westernmost edge
of the existing
Right-of-Way
From TS-9 To The Dove
Valley Road alignment

3,000' (1,500' north & 1,500' south) centered
on the section line designating
the Dove Valley Road alignment from
the Navajo 500kV Transmission Line Corridor
to the 38th Ave. alignment

2,000' (1,000' each side) centered
on the alignment between the intersection
of 38th Ave & Lone Mountain Rd. and
Lat. 33.7, Long. -112.13

2,000' (1,000' east & west) centered on
the mid-section line designating 38th Ave.


500' west of existing
ADOT Right-of-Way from south of
Lat. 33.7, Long. -112.13 to Oberlin Way

1,000' west of existing
ADOT Right-of-Way from Oberlin Way
to 7/4 mile south of Happy Valley Rd.

See Map Inset

175' north of the centerline of the
existing 230kV structures from
28th Ave. to 56th St.

1,500' north of the centerline
of the existing 230kV structures
from 56th St. to the line termination
at the Pinnacle Peak Substation
located in Section 10, Township 4 North,
Range 1 East

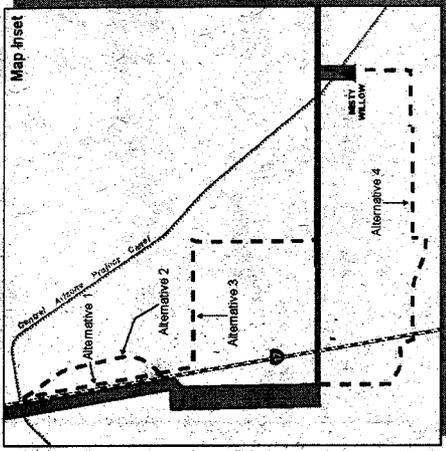

- Proposed Corridor
- Potential Alignment Alternative
- Future Substation
- Segment Node
- Existing Substation
- Interstate Highway
- State Highway
- Canal

Carefree Hwy.
Dove Valley Rd.
Lone Mountain Rd.
Dixielita Dr.
Dynamite Bld.
Oberlin Way
Jomax Rd.
Happy Valley Rd.
PINNACLE PEAK
Pinnacle Peak Rd.
Deer Valley Rd.
Beardsley Rd.

67th Ave.
51st Ave.
38th Ave.
35th Ave.
7th Ave.
Central Ave.
40th St.
56th St.
Cave Creek Rd.

Lake Proserpio
Racewater
Agua Fria River
Central Arizona Project Canal
MISTY WILLOW