

OPEN MEETING AGENDA ITEM
ORIGINAL SOUTHWESTERN

RECEIVED Power Group II, LLC

An Energy Company - Alliance Builder

2007 JAN 31 P 4: 24

AZ CORP COMMISSION
DOCUMENT CONTROL

January 29, 2007

Docket Control
Arizona Corporation Commission
1200 West Washington
Phoenix, Arizona 85007

Arizona Corporation Commission
DOCKETED

JAN 31 2007

DOCKETED BY NR

Re: Bowie Power Station, L.L.C.
10-Year Plan For 2007
(Docket No. L-00000BB-01-0118)

To Whom It May Concern:

Pursuant to A.R.S. § 40-360.02 (A) and (C), Bowie Power Station, L.L.C. ("Bowie") hereby submits its 10-Year Plan for 2007 for the transmission line facilities which are the subject of the Certificate of Environmental Compatibility ("CEC") which was granted by the Commission on March 7, 2002 in Decision No. 64626. As used herein, the phrase "transmission line" includes all facilities contained within the definition of that phrase as set forth in A.R.S. § 40-360.

Attached hereto as Appendix "A" and incorporated by reference is a copy of the 10-Year Plan Bowie filed with the Commission for 2006. The only change in the information contained in the 2006 10-Year Plan relating to the transmission line, which has occurred during the intervening time period, pertains to the proposed route.

More specifically, representatives of the Arizona State Land Department ("ASLD") and Bowie recently agreed upon certain minor adjustments to the route of the transmission line as it traverses ASLD land, in order to comply with a recently formulated ASLD policy that electric transmission line right(s)-of-way parallel section lines on ASLD to the maximum extent practicable. Accordingly, and pursuant to A.R.S. § 40-360.02 (C)(1), attached hereto as Appendix "B" is a copy of a map which indicates the nature and location of those changes in the transmission line route as it crosses ASLD land. In all other respects, as pertinent to the transmission line, the information required under A.R.S. § 40-360.02 (C) remains the same as contained in the attached copy of Bowie's 2006 10-Year Plan.

As the Commission and its Staff are aware, Bowie does under consideration the possibility of re-permitting the natural gas-fired electric generating plant, which was the subject

3610 North 44th Street • Suite 250 • Phoenix, Arizona 85018
888.332.4599 • Tel 602.808.2004 • Fax 602.808.2099
www.southwesternpower.com




0000066186

50TP

of the CEC granted by the Commission in companion Decision No. 64625, as an Integrated Gasification Combined Cycle ("IGCC") electric generating plant. In the event that Bowie pursues that course of action, and the Commission either amends the existing power plant CEC or grants a new CEC, Bowie will file such changes to this 2007 10-Year Plan for the transmission line as may be necessary or appropriate; or, depending upon timing, it will reflect such changes in its 10-Year Plan for 2008.

Please let me know if you have any questions regarding the above information or the attached appendices.

Sincerely,

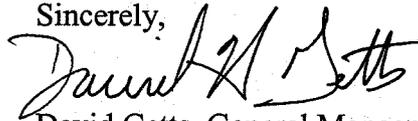

David Getts, General Manager
Bowie Power Station, L.L.C.

cc: Ernest Johnson (ACC Utilities Division)
Christopher Kempley (ACC Legal Division)
Laurie Woodall (Chairman, ACC Legal Division)
Gary Crane (Environmental Manager, SWPG)
Lawrence V. Robertson, Jr. (Munger Chadwick, PLC)

APPENDIX "A"

SOUTHWESTERN
Power Group II, LLC
An Energy Company - Alliance Builder

RECEIVED

2006 JAN 31 P 3:02

January 31, 2006
ARIZONA CORPORATION COMMISSION
DOCUMENT CONTROL

Ms. Colleen Ryan, Supervisor
Document Control Center
Arizona Corporation Commission
1200 West Washington
Phoenix, Arizona 85007

**Re: Update For 2006
Annual Ten-Year Plan For Bowie Power Station, L.L.C.
(Docket No. L-00000BB-01-0118)**

Dear Ms. Ryan:

The purpose of this letter is to provide notice that Southwestern Power Group II, L.L.C. ("SWPG") is updating its 2006 Ten-Year Plan (see attachment) for the Bowie Power Station. Our update is meant to address provision A.R.S. § 40-360.02. With this provision in mind, SWPG advises that we are contemplating that the fully permitted natural gas fired Bowie Power Station may be re-permitted as a coal-fired facility. In addition, SWPG is contemplating a new 51-mile transmission alignment from the Bowie Power Station to the Winchester Substation.

In the event that SWPG ultimately decides to proceed with the newly proposed coal project, SWPG will make all required filings, including those prescribed in A.R.S. §§ 40-360 *et seq.*

Please let me know if you have any questions.

Sincerely,



Tom Wray
General Manager

Cc:

Ernest Johnson w attachments (Utility Director)
Jerry Smith w attachments (Utility Engineer)
Gary Crane w/o attachments (SWPG)
Laurie Woodall w attachments (Chairman, Siting Committee)
Lawrence V. Robertson w attachments (Munger Chadwick, PLC)

SOUTHWESTERN
Power Group II, LLC
An Energy Company - Alliance Builder

January 31, 2006

Ms. Colleen Ryan, Supervisor
Document Control Center
Arizona Corporation Commission
1200 West Washington
Phoenix, Arizona 85007

Re: Annual Ten-Year Plan For Bowie Power Station, L.L.C.
(Docket No. L-00000BB-01-0118)

Dear Ms. Ryan:

Pursuant to Arizona Revised Statutes (A.R.S. 40-360.02), Bowie Power Station L.L.C. ("Bowie") hereby submits its current (January 31, 2006) Ten-Year Plan for the fully permitted electric generating station and associated transmission line. In order to simplify the current plan for the reader, Bowie will differentiate changes made from the Ten-Year Plan of January 2005. For reference, the January 2005 plan is provided at the end of this letter. The same organization requirements specified in A.R.S. 40-360.02, and protocol used in the past (i.e. 2002, 2003, 2004 & 2005) Ten-Year Plan will be followed in this plan. The requirements within the revised statutes are formatted in italics, and are followed by Bowie's response in normal (non-italicized) type.

1. *The size and proposed route of any transmission lines or location of each plant proposed to be constructed.*

There are no known changes in the size and proposed route of transmission line or location of the proposed gas power plant.

2. *The purpose to be served by each proposed line or plant.*

There are no known changes in the purpose of the proposed line or power plant as specified in the 2005 Ten-Year Plan.

3. *The estimated date by which each transmission line or plant will be in operation.*

Bowie is in the process of renewing its air permit and anticipates the permit to be renewed in February 2006. Construction schedule for both the power plant and transmission line is dependent on power purchasers in either Arizona or Mexico. Construction of both the transmission facility and power station will commence concurrently after a contractual arrangement is entered into with a power purchaser.

SOUTHWESTERN
Power Group II, LLC
An Energy Company - Alliance Builder

4. *The average and maximum power output measured in megawatts of each plant installed.*

There are no known changes on the average and maximum power output as specified in the 2005 Ten-Year Plan.

5. *The expected capacity factor for each proposed plant.*

There are no known changes on the expected capacity factor for the proposed power plant as specified in the 2005 Ten-Year Plan.

6. *The type of fuel to be used for each proposed plant*

There are no known changes on the type of fuel to be used for the proposed power plant as specified in the 2005 Ten-Year Plan.

7. *The plans' for any new facilities shall include a power flow and stability analysis report showing the effect on the current Arizona electric transmission system. Transmission owners shall provide the technical reports, analysis or basis for projects that are included for serving customer load growth in their service territories.*

There are no known changes or updates to the Interconnection System Impact Study completed in cooperation with Tucson Electric Power submitted with the 2003 Ten-Year Plan.

In the event you have any questions regarding the above, please feel free to contact me at (602) 808-2004.

Sincerely,



Tom Wray
General Manager

Cc:

Ernest Johnson w attachments (Utility Director)
Jerry Smith w attachments (Utility Engineer)
Gary Crane w/o attachments (SWPG)
Laurie Woodall w attachments (Chairman, Siting Committee)
Lawrence V. Robertson w attachments (Munger Chadwick, PLC)

ATTACHMENTS

SOUTHWESTERN
Power Group II, LLC
An Energy Company - Alliance Builder

January 31, 2005

Ms. Colleen Ryan, Supervisor
Document Control Center
Arizona Corporation Commission
1200 West Washington
Phoenix, Arizona 85007

Re: Annual Ten-Year Plan For Bowie Power Station, L.L.C.
(Docket No. L-00000BB-01-0118)

Dear Ms. Ryan:

Pursuant to Arizona Revised Statutes (A.R.S. 40-360.02), Bowie Power Station L.L.C. ("Bowie") hereby submits its current (January 31, 2005) Ten-Year Plan for the fully permitted electric generating station and associated transmission line. In order to simplify the current plan for the reader, Bowie will differentiate changes made from the Ten-Year Plan of January 2003 & 2004. For reference, both the January 2003 and 2004 plan is provided at the end of this letter. The same organization requirements specified in A.R.S. 40-360.02, and protocol used in the 2003 & 2004 Ten-Year Plan will be followed in this plan. The requirements within the revised statutes are formatted in italics, and are followed by Bowie's response in normal (non-italicized) type.

1. *The size and proposed route of any transmission lines or location of each plant proposed to be constructed.*

There are no known changes in the size and proposed route of transmission line or location of the proposed power plant. This is consistent with the 2003 and 2004 Ten-Year Plan. Discussions with the Arizona State Land Department (ASLD) in regard to Bowie's transmission corridor have terminated until contractual arrangements are executed with load-serving entities in the United States or in Mexico. In the event Bowie enters into a contractual arrangement with a potential power purchaser, discussions will be renewed with the ASLD and appropriate filings will be made with the Arizona Power Plant and Transmission Line Siting Committee and as needed other regulatory entities.

2. *The purpose to be served by each proposed line or plant.*

There are no known changes in the purpose of the proposed line or power plant as specified in the 2003 and 2004 Ten-Year Plan. See Response No. 1 above as to current discussions and investigations that are ongoing.

3. *The estimated date by which each transmission line or plant will be in operation.*

Bowie is in the process of renewing its air permit and anticipates the permit to be renewed in June 2005. Construction schedule remains the same and is dependent on

4350 East Camelback Road • Suite B175 • Phoenix, Arizona 85018

P.O. Box 15491 • Phoenix, Arizona 85060

888.332.4559 • Tel 602.808.2004 • Fax 602.808.2099

www.southwesternpower.com

power purchasers in either Arizona or Mexico. Bowie anticipates commencing construction for the power station in the following time sequence:

Phase 1	4 th quarter 2006
Phase 2	4 th quarter 2007

The anticipated commercial in-service operation for the 345 kV and 230 kV transmission facilities associated with the power station will be no later than 4th quarter 2006. Construction of both the transmission facility and power station will commence concurrently after a contractual arrangement is entered into with a power purchaser.

4. *The average and maximum power output measured in megawatts of each plant installed.*

There are no known changes on the average and maximum power output as specified in the 2003 and 2004 Ten-Year Plan.

5. *The expected capacity factor for each proposed plant.*

There are no known changes on the expected capacity factor for the proposed power plant as specified in the 2003 and 2004 Ten-Year Plan.

6. *The type of fuel to be used for each proposed plant*

There are no known changes on the type of fuel to be used for the proposed power plant as specified in the 2003 and 2004 Ten-Year Plan.

7. *The plans' for any new facilities shall include a power flow and stability analysis report showing the effect on the current Arizona electric transmission system. Transmission owners shall provide the technical reports, analysis or basis for projects that are included for serving customer load growth in their service territories.*

There are no known changes or updates to the Interconnection System Impact Study completed in cooperation with Tucson Electric Power submitted with the 2003 Ten-Year Plan.

In the event you have any questions regarding the above, please feel free to contact me at (602) 808-2004.

Sincerely,




Tom Wray
General Manager

Cc:

Ernest Johnson w attachments (Utility Director)
Jerry Smith w attachments (Utility Engineer)
Gary Crane w/o attachments (SWPG)
Laurie Woodall w attachments (Chairman, Siting Committee)
Lawrence V. Robertson w attachments (Munger Chadwick, PLC)

APPENDIX "B"

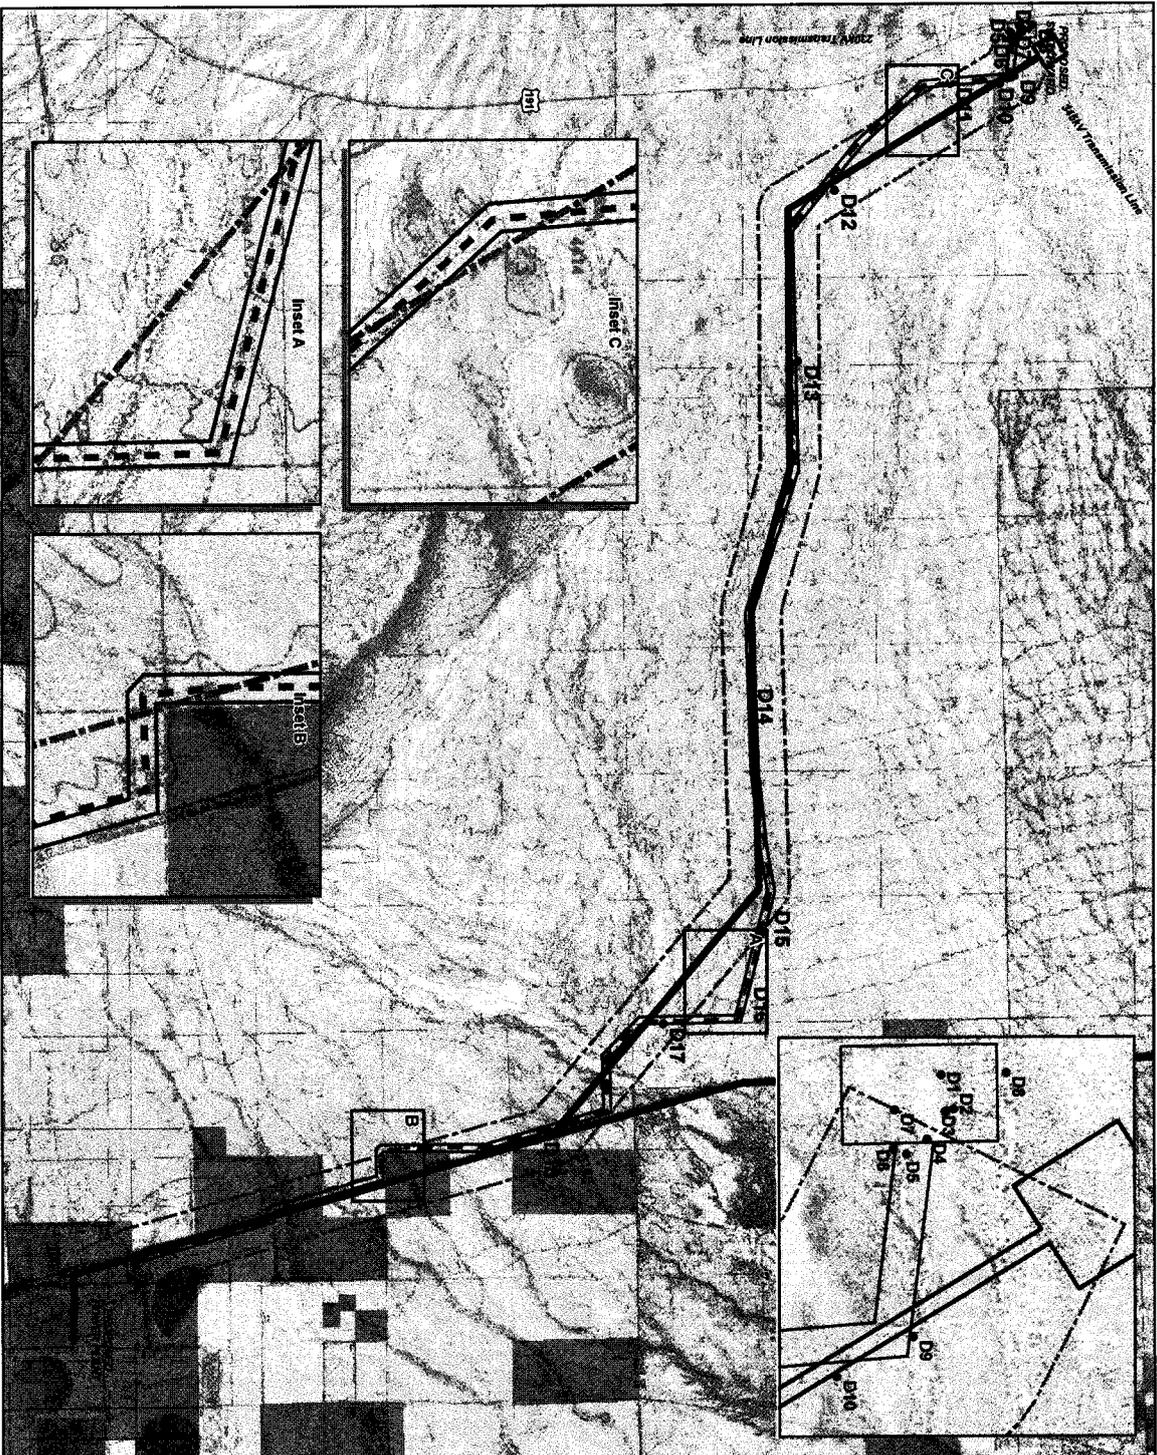

**TRANSMISSION LINE
ALTERNATIVES**

OPTION C

LEGEND

- .-.- Alternative Transmission Line
 - [] Approved 345KV Transmission Line Corridor - Certificate of Environmental Compatibility (2002)
 - [] 300' ASLD Easement
 - [] 120' 2001 Class III Cultural Survey Corridor
- Land Ownership**
- [] BLM
 - [] State
 - [] Private

DRAFT: January 15, 2007

