

ORIGINAL



0000122667

Tucson Electric Power Company
P.O. Box 711, Tucson, AZ 85702
One South Church Avenue, Suite 200, Tucson, Arizona 85701

January 31, 2011

Docket Control
Arizona Corporation Commission
1200 West Washington Street
Phoenix, AZ 85007

Re: **Docket No. E-00000D-11-0017**

Pursuant to ARS § 40-360.02, please find enclosed an original and thirteen copies of Tucson Electric Power Company's ("TEP") 2011-2020 Ten-Year Plan.

Sincerely,

Jessica Bryne
Regulatory Services
Tucson Electric Power Company
520-884-3680

Arizona Corporation Commission
DOCKETED

JAN 31 2011


DOCKETED BY

cc: Steve Olea, ACC
Prem Bahl, ACC
Compliance, ACC

ARIZONA CORPORATION
COMMISSION
DOCKET CONTROL

2011 JAN 31 P 12:10

RECEIVED

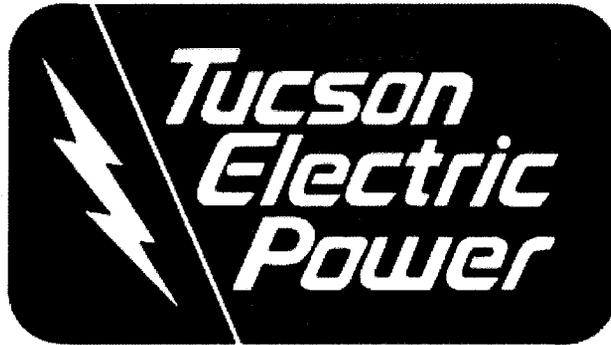

A UniSource Energy Company

TUCSON ELECTRIC POWER COMPANY
TEN YEAR PLAN
FOR YEARS
2011-2020

SUBMITTED TO THE
ARIZONA CORPORATION COMMISSION
JANUARY 2011

DOCKET NO: E-00000D-11-0017

CONTENTS

INTRODUCTION	3
<i>Pinal West Substation to Pinal Central Substation</i>	<i>10</i>
<i>Pinal Central Substation to Tortolita Substation.....</i>	<i>11</i>
<i>Tortolita Substation to North Loop circuit #1 and #2</i>	<i>12</i>
<i>Interconnection of Greenlee – Winchester 345 kV with future Willow 345 kV Substation.....</i>	<i>13</i>
<i>Vail Substation to Irvington Substation.....</i>	<i>14</i>
<i>Irvington Substation to South Substation.....</i>	<i>15</i>
<i>Tortolita Substation to Winchester Substation</i>	<i>16</i>
<i>Winchester Substation to Vail Substation – circuits #2 and #3</i>	<i>17</i>
<i>Vail Substation to South Substation – 2nd circuit.....</i>	<i>18</i>
<i>Springerville Substation to Greenlee Substation - 2nd circuit.....</i>	<i>19</i>
<i>Tortolita Substation to South Substation</i>	<i>20</i>
<i>Westwing Substation to South Substation – 2nd circuit.....</i>	<i>21</i>
<i>TEP-UNS Electric 345 kV Interconnection --South Substation to future Gateway Substation (2 cks.).....</i>	<i>22</i>
<i>Gateway Substation to Comision Federal de Electricidad (CFE) (2 cks.).....</i>	<i>23</i>
<i>SunZia Southwest Transmission 500kV Project</i>	<i>24</i>
<i>Series Capacitor Replacement at Vail 345kV Substation (Winchester – Vail 345kV Line).....</i>	<i>25</i>
<i>Series Capacitor Replacement at Vail 345kV Substation (Springerville – Vail 345kV Line).....</i>	<i>26</i>
<i>McKinley 345kV Substation Reactor Addition.....</i>	<i>27</i>
<i>Tortolita 500/138kV Transformer T3</i>	<i>28</i>
<i>Vail 345/138kV Transformer T3.....</i>	<i>29</i>
<i>Vail 345/138kV Transformer T4.....</i>	<i>30</i>
HV FACILITIES	33
<i>Irvington Substation to East Loop Substation (through 22nd Street Substation)</i>	<i>33</i>
<i>Vail Substation to East Loop Substation through Spanish Trail and Roberts Substations, tapping the Roberts-East Loop line for new Harrison Substation.....</i>	<i>34</i>
<i>Interconnection of South – Midvale 138 kV circuit with future Spencer, Raytheon, Medina 138kV substations</i>	<i>36</i>
<i>South Substation to Duval CLEAR Switchyard through future Canoa Ranch Substation and Green Valley Substation</i>	<i>38</i>
<i>Rancho Vistoso Substation to future Sun City Substation.....</i>	<i>40</i>
<i>Loop existing Irvington Station to Vail Substation #2 line through future University of Arizona Tech Park Substation</i>	<i>41</i>
<i>Tortolita Substation – North Loop Substation, North Loop Substation – Rancho Vistoso Substation and Tortolita – Rancho Vistoso 138 kV corridor expansion and reconfiguration.....</i>	<i>42</i>
<i>Vail Substation – Cienega Substation – Spanish Trail Substation 138 kV</i>	<i>44</i>
<i>Northeast – Snyder 138 kV – tap for Craycroft-Barril Substation</i>	<i>45</i>
<i>Interconnection of Tortolita – North Loop 138 kV with future TEP Marana 138 kV Substation</i>	<i>46</i>
<i>Tortolita Substation - Rancho Vistoso Substation 138kV tap for new Naranja Substation.....</i>	<i>47</i>
<i>DeMoss Petrie Substation – Tucson Station 138 kV.....</i>	<i>48</i>
<i>Irvington Substation – Corona Substation –South Substation 138kV.....</i>	<i>49</i>
<i>La Canada Substation – Orange Grove Substation– Rillito Substation 138kV.....</i>	<i>50</i>
<i>Orange Grove Substation– East Ina Substation 138kV.....</i>	<i>51</i>
<i>South Substation – Hartt Substation– Green Valley Substation 138kV.....</i>	<i>52</i>
<i>Del Cerro Substation – Anklam Substation – Tucson Station 138kV</i>	<i>53</i>
<i>TEP System to Rosemont Substation 138 kV.....</i>	<i>54</i>
<i>Irvington Substation –Tucson Station #2 138 kV.....</i>	<i>55</i>
<i>Rancho Vistoso – La Canada 138kV Line Reconductor</i>	<i>57</i>
<i>Los Reales - Vail 138kV Line Reconductor</i>	<i>58</i>
<i>North East Loop - Rillito 138kV Line Reconductor.....</i>	<i>59</i>
<i>Irvington – Robert Bills-Wilmot 138kV Line Reconductor.....</i>	<i>60</i>
<i>Los Reales - Pantano 138kV Line Reconductor.....</i>	<i>61</i>
<i>DeMoss Petri – North East Loop 138kV Line Reconductor</i>	<i>62</i>
<i>North Loop – Rillito 138kV Line Reconductor</i>	<i>63</i>
<i>Rosemont Point of Interconnection STATCOM.....</i>	<i>64</i>

INTRODUCTION

EHV Transmission System

Tucson Electric Power Company (TEP) is a member of the WestConnect Planning Area and the Southwest Area Transmission (SWAT) Sub-Regional Planning Group. TEP participates in various SWAT subcommittees, work groups, and task forces including: Central Arizona Transmission (CATS), Colorado River Transmission (CRT), Southeast Arizona Transmission System (SATS), and Renewable Energy Transmission Task Force (RTTF). Each of these subcommittees has been involved in studying various generation and transmission projects to enhance and increase utilization of the existing system. The SATS study includes all or part of Pima, Pinal, Cochise, and Santa Cruz counties and has the largest direct impact on TEP. TEP has chaired this subcommittee since its inception and was responsible for filing the 2010 SATS Report on behalf of the SATS participants.

TEP is a participant in the Pinal West - Pinal Central portion of the SRP Pinal West - Abel/Browning 500 kV Project. TEP plans to construct a 500 kV line between the proposed Pinal Central Switchyard and TEP's Tortolita Substation. The Pinal Central to Tortolita 500kV project is scheduled to be in-service in 2014.

TEP is evaluating various EHV alternatives to increase load serving capability within TEP's control area. Capability of the EHV and 230kV lines between Greenlee and Vail will need to be increased. Projects under consideration include a 345 kV line between

TEP's South and Vail substations with a loop in at the Irvington Station, EHV transmission lines between TEP's Tortolita and North Loop Substations, and a double circuit 345 kV line between TEP's Winchester and Vail Substations. In addition, TEP is a funding participant in the siting efforts for the SunZia Transmission Project and a study participant in the Southline Project. Additional local 138kV system reinforcement alternatives are also being considered within TEP's service territory.

Following the 6th Biennial Transmission Assessment performed in 2010, the Arizona Corporation Commission (Commission) Decision No. 72031 (December 10, 2010) which required the jurisdictional utilities to include "the effects of distributed renewable generation and energy efficiency programs on future transmission need in future ten-year plan filings, beginning in January 2011." These items are reflected in the TEP load forecast.

138kV Local Transmission System

TEP performs an annual review of its 138kV system performance over a ten-year planning horizon. This results in a schedule for new facilities and upgrades to existing facilities assuring adequate transmission capacity within TEP's service territory as the Tucson metropolitan area continues to develop. Capital improvements are proposed to be made to the TEP 138kV system to accommodate new 138/13.8kV substations, address increased line loading, and mitigate localized stability issues.

Load projection analysis focuses on distribution system needs and shows the impact of load growth at each of TEP's distribution substations. This results in identification of proposed new 138/13.8 kV substations and new 138kV transmission lines. Load projection also provides input to the power flow analysis used to identify thermal overloads as loads in Tucson continue to grow.

Power flow analysis is conducted to identify thermal overloads and voltage violations under normal and contingency conditions as required by the NERC Reliability Standards and the WECC System Performance Criteria. Mitigation is then determined such that the performance measures of the NERC Reliability Standards and WECC System Performance Criteria are met for Category A, B and C conditions.

Contingencies include:

- Loss of major EHV import transmission facilities
- Loss of critical local generation
- Single 138kV circuit outages
- Credible 138kV multiple circuit outages
- Critical circuits initially out of service with the system adjusted to normal conditions followed by a subsequent outage.

Violations of the NERC Reliability Standards and WECC System Performance Criteria are mitigated by proposed system improvements including the following:

- New transmission lines;

- Uprate existing lines (increase conductor clearances, or replace station equipment);
- Reconductor existing circuits;
- New local generation (when more cost effective than transmission);
- Additional 138 kV shunt capacitor banks;
- Other cost effective measures.

Stability issues are resolved through transmission system reinforcement and/or the application of Flexible AC Transmission System (FACTS) devices. For example, TEP plans to install a 12.5 MVar STATCOM at the Rosemont Point of Interconnection Switchyard following the addition of the Rosemont load to the TEP 138 kV system and completion of the loop of the Green Valley 138 kV transmission system. The STATCOM will control three (3) additional mechanically switched capacitor banks at this location.

TEP EHV and local area 138kV transmission systems with facility additions or uprates are shown graphically in Figures 1, 2, and 3, and followed by individual project descriptions. Note that in service dates shown as "TBD" are beyond the ten year horizon. Figure 1. *Existing and Planned EHV Transmission Facilities Map* and Figure 2. *Existing and Planned EHV Transmission Facilities One-Line Diagram* show existing and proposed EHV transmission for portions of TEP and neighboring systems. Existing TEP-owned or TEP-participant 500kV, 345kV, 230kV, and 138 kV lines are depicted as solid red, green, blue, and orange lines respectively. Proposed lines are shown in the same colors, but as thicker dashed lines. Lines owned by others are shown in the same

color but as dotted lines. Proposed Substations are shown in the same color but with a black border.

NERC/WECC Reliability Audits

Commission Decision No. 72031 (December 10, 2010) also required the jurisdictional utilities "to report relevant findings in future BTAs regarding compliance with transmission planning standards (e.g., TPL-001 through TPL-004) from NERC/WECC reliability audits that have been finalized and filed with FERC." TEP's last audit to monitor compliance with NERC Reliability Standards and WECC System Performance Criteria was conducted in 2008. The next scheduled audit will be conducted in August, 2011. Any relevant findings of this audit will be reported in the Ten-Year Plan immediately following the filing of such findings with FERC.

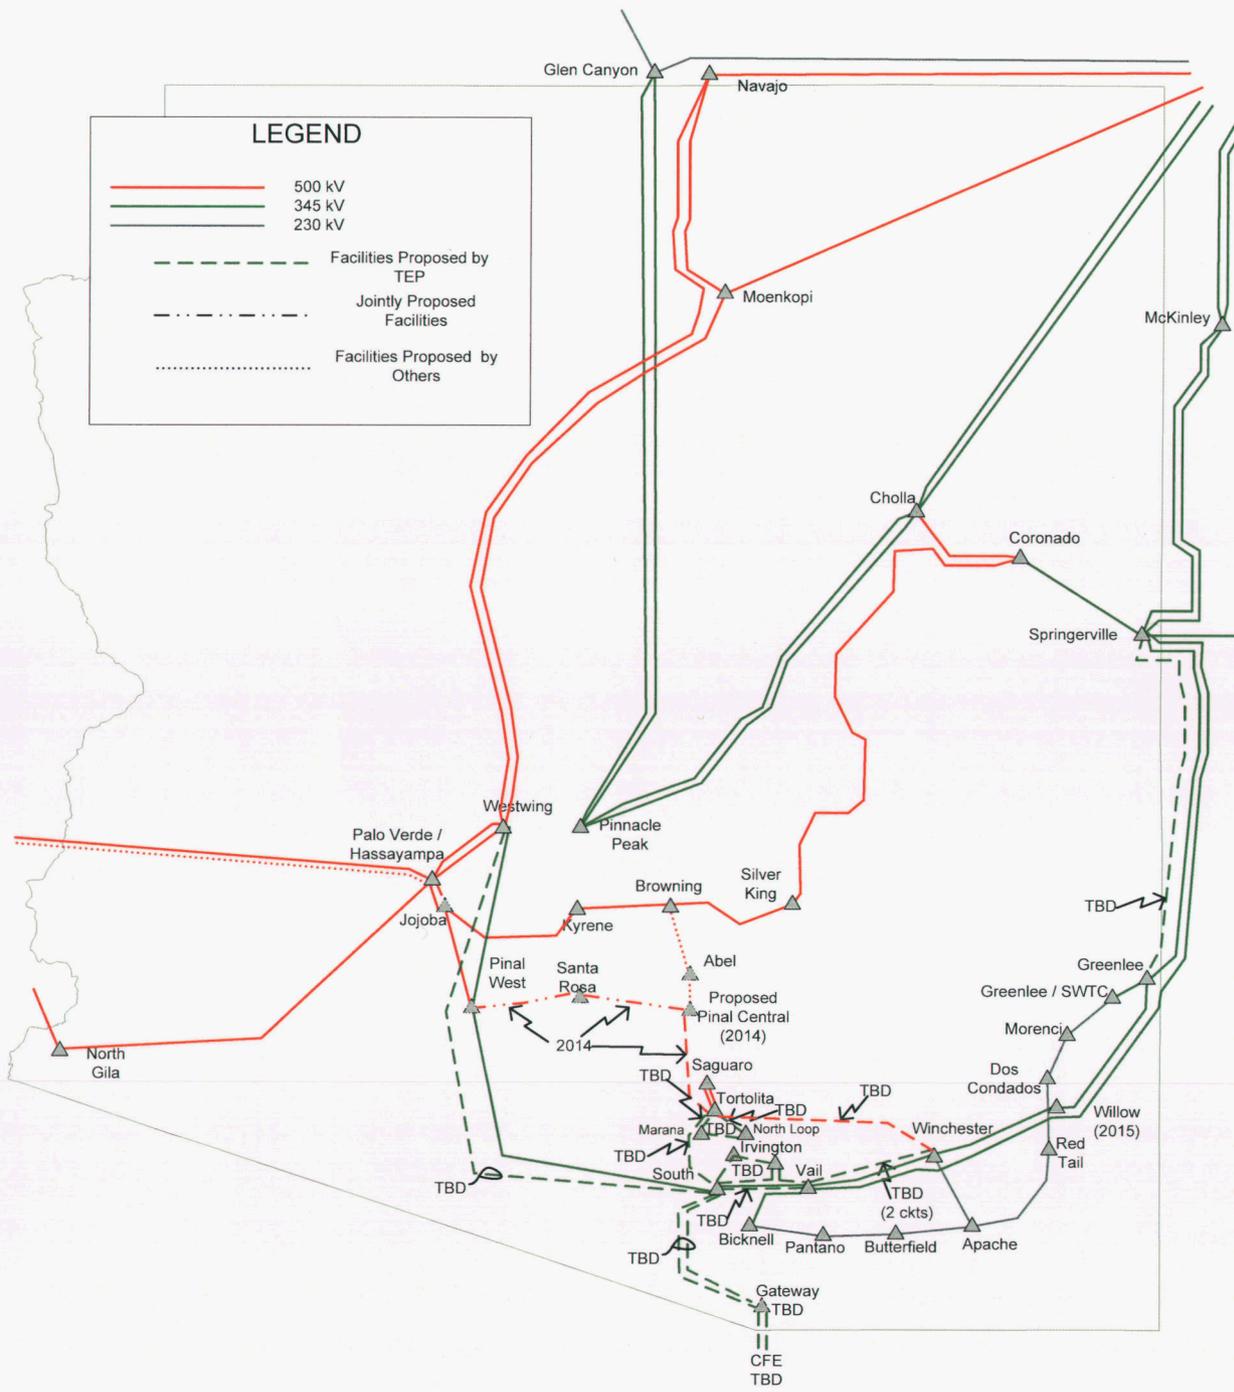


Figure 1. Existing and Planned EHV Transmission Facilities Map

TEP EHV Transmission System Single Line

2011 Ten-Year Plan (2011 – 2020)

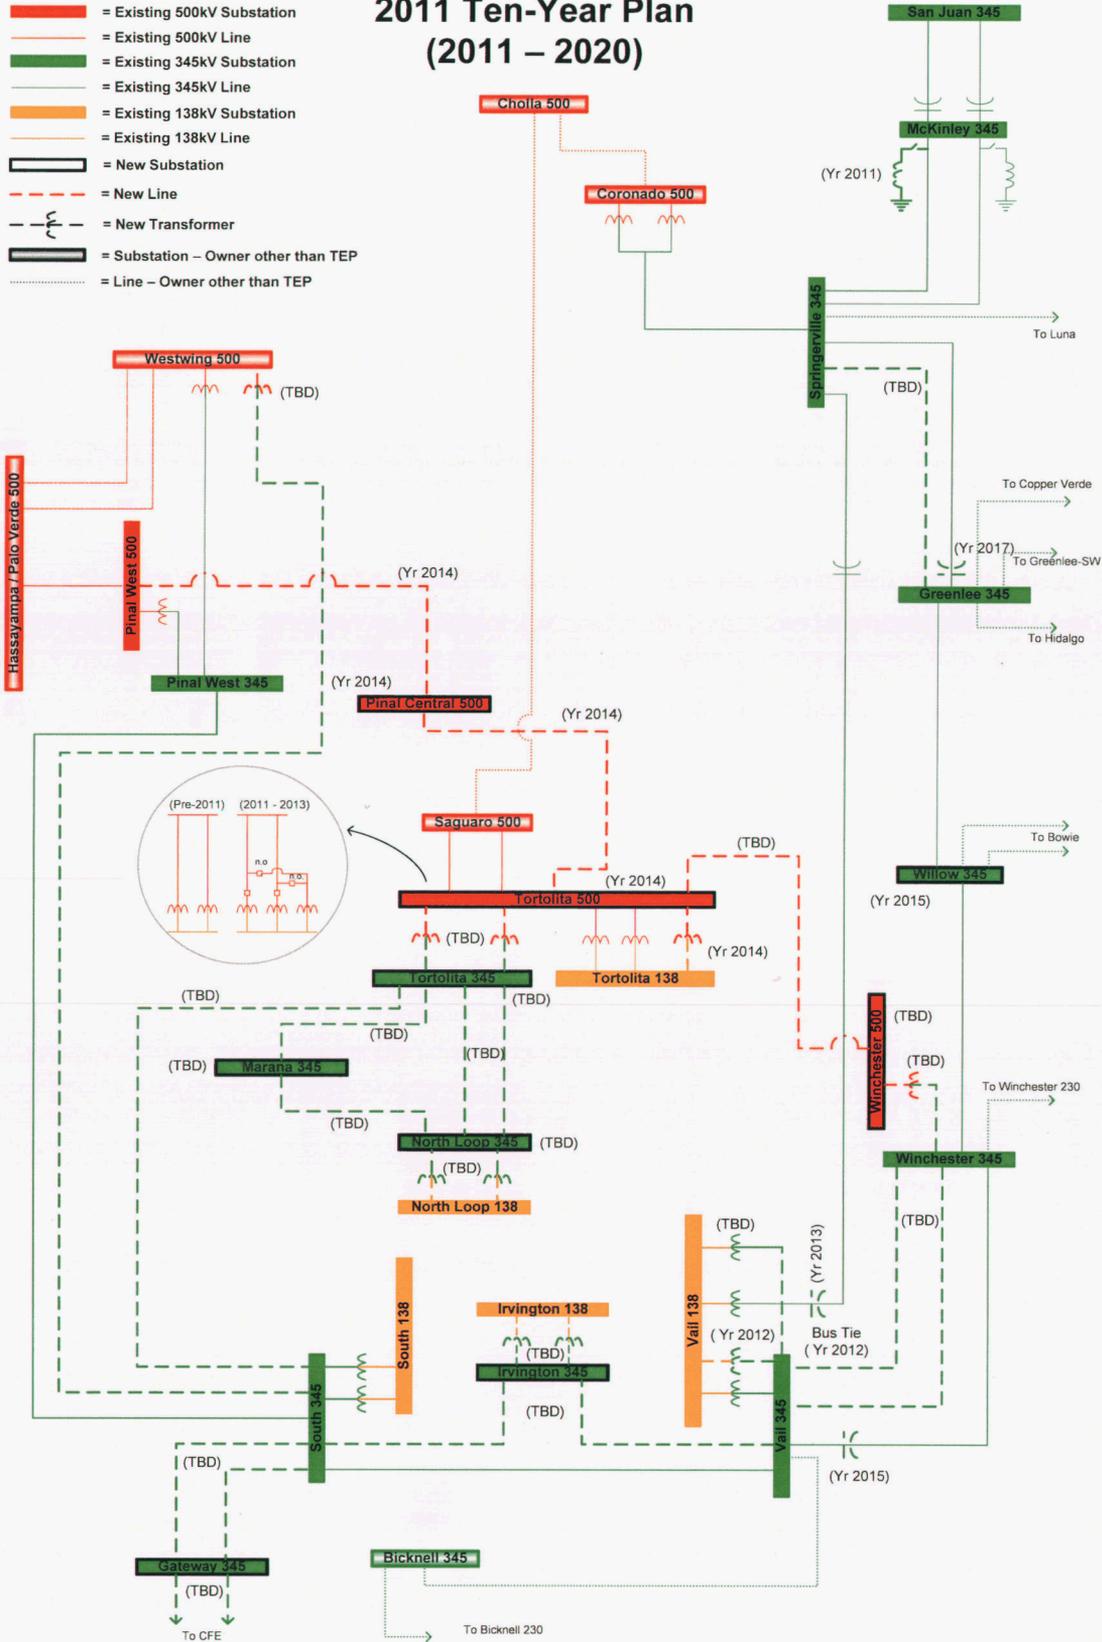


Figure 2. Existing and Planned EHV Transmission Facilities Single-Line Diagram

TUCSON ELECTRIC POWER COMPANY

10 YEAR PLAN

TRANSMISSION FACILITIES

Line Designation	Pinal West Substation to Pinal Central Substation
Size	
a) Voltage	500-kV
b) Capacity	1500 MVA
c) Point of Origin	Pinal West substation
d) Point of Termination	Future Pinal Central Substation
e) Length	Approximately 38 miles
Routing	South and east from the Pinal West substation to approximately Teel Road, then east to the vicinity of the Santa Rosa substation. From Santa Rosa easterly to approximately the Santa Rosa Wash, then generally south to approximately a half mile north of I-8 where it turns east again. Then it runs easterly to about the location of the ED2 substation (Sec 25, T6S, R7E).
Purpose	TEP is a participant in the project that will provide a higher capacity link for the flow of power from the Palo Verde area into TEP's northern service territory.
Date	
a) Construction Start	2012
b) In-Service Date	2014
Is Certificate Necessary	Case Number 126
Technical Studies	Completed

TUCSON ELECTRIC POWER COMPANY

10 YEAR PLAN

TRANSMISSION FACILITIES

Line Designation	Pinal Central Substation to Tortolita Substation
Size	
a) Voltage	500-kV
b) Capacity	System dependent
c) Point of Origin	Future Pinal Central substation
d) Point of Termination	Tortolita Substation (Sec. 14 T10S R10E)
e) Length	Approximately 38 miles
Routing	Unknown
Purpose	To reinforce TEP's EHV system and to provide a higher capacity link for the flow of power from the Palo Verde area into TEP's northern service territory.
Date	
a) Construction Start	2012
b) In-Service Date	2014
Is Certificate Necessary	Yes
Technical Studies	Completed

TUCSON ELECTRIC POWER COMPANY

10 YEAR PLAN

TRANSMISSION FACILITIES

Line Designation	Tortolita Substation to North Loop circuit #1 and #2
Size	
a) Voltage	345-kV or 500-kV
b) Capacity	System dependent
c) Point of Origin	Tortolita Substation (Sec. 14 T10S R10E)
d) Potential Interim Point	SWTC Marana Substation
e) Point of Termination	North Loop Substation
f) Length	Approximately 15 miles
Routing	Unknown
Purpose	To reinforce TEP's EHV system and to provide a new tie between TEP's HV and EHV systems.
Date	
a) Construction Start	TBD
b) In-Service Date	TBD
Is Certificate Necessary	Yes
Technical Studies	Studies in progress via SATS, SWAT and internal TEP study efforts.

TUCSON ELECTRIC POWER COMPANY

10 YEAR PLAN

TRANSMISSION FACILITIES

Line Designation	Interconnection of Greenlee - Winchester 345 kV with future Willow 345 kV Substation
Size	
a) Voltage	345-kV
b) Capacity	System dependent
c) Point of Origin	Greenlee - Winchester
d) Point of Termination	Future Willow substation
e) Length	Less than 1 mile
Routing	Adjacent to Greenlee - Winchester 345 kV line.
Purpose	To accommodate interconnection of Bowie Power Station.
Date	
a) Construction Start	2014
b) In-Service Date	2015
Is Certificate Necessary	CEC was obtained by Southwestern Power Group - Case number 118
Technical Studies	SATS and Interconnection Studies per TEP OATT.

TUCSON ELECTRIC POWER COMPANY

10 YEAR PLAN

TRANSMISSION FACILITIES

Line Designation	Vail Substation to Irvington Substation
Size	
a) Voltage	345-kV
b) Capacity	System dependent
c) Point of Origin	Vail Substation (Sec. 4 T16S R15E)
d) Point of Termination	Irvington Substation (Sec. 03 T15S R14E)
e) Length	Approximately 11 miles
Routing	Unknown
Purpose	To reinforce TEP's EHV system and to provide a new tie between TEP's HV and EHV systems.
Date	
a) Construction Start	TBD
b) In-Service Date	TBD
Is Certificate Necessary	Yes
Technical Studies	Studies in progress via SATS, SWAT and internal TEP study efforts.

TUCSON ELECTRIC POWER COMPANY

10 YEAR PLAN

TRANSMISSION FACILITIES

Line Designation	Irvington Substation to South Substation
Size	
a) Voltage	345-kV
b) Capacity	System dependent
c) Point of Origin	Irvington Substation (Sec. 03 T15S R14E)
d) Point of Termination	South Substation (Sec. 36 T16S R13E)
e) Length	Approximately 16 miles
Routing	Unknown
Purpose	To reinforce TEP's EHV system and to provide a new tie between TEP's HV and EHV systems.
Date	
a) Construction Start	TBD
b) In-Service Date	TBD
Is Certificate Necessary	Yes
Technical Studies	Studies in progress via SATS, SWAT and internal TEP study efforts.

TUCSON ELECTRIC POWER COMPANY

10 YEAR PLAN

TRANSMISSION FACILITIES

Line Designation	Tortolita Substation to Winchester Substation
Size	
a) Voltage	500-kV
b) Capacity	System dependent
c) Point of Origin	Tortolita Substation (Sec. 14 T10S R10E)
d) Point of Termination	Winchester Substation
e) Length	Approximately 80 miles
Routing	As described in Siting Case Number 23
Purpose	To reinforce TEP's EHV system and to provide a higher capacity link for the flow of power from the Palo Verde area into TEP's eastern transmission system.
Date	
a) Construction Start	TBD
b) In-Service Date	TBD
Is Certificate Necessary	Case Number 23
Technical Studies	Studies in progress via SWAT, SATS and internal TEP study efforts.

TUCSON ELECTRIC POWER COMPANY

10 YEAR PLAN

TRANSMISSION FACILITIES

Line Designation	Winchester Substation to Vail Substation – circuits #2 and #3
Size	
a) Voltage	345-kV
b) Capacity	System dependent
c) Point of Origin	Winchester Substation
d) Point of Termination	Vail Substation (Sec. 4 T16S R15E)
e) Length	Approximately 40 miles
Routing	Parallel to existing Winchester – Vail Line
Purpose	To reinforce TEP's EHV system and to provide additional transmission capacity from the Winchester Station into Tucson
Date	
a) Construction Start	TBD
b) In-Service Date	TBD
Is Certificate Necessary	Yes
Technical Studies	Studies in progress via SWAT, SATS and internal TEP study efforts.

TUCSON ELECTRIC POWER COMPANY

10 YEAR PLAN

TRANSMISSION FACILITIES

Line Designation	Vail Substation to South Substation - 2 nd circuit
Size	
a) Voltage	345-kV
b) Capacity	System dependent
c) Point of Origin	Vail Substation (Sec. 4 T16S R15E)
d) Point of Termination	South Substation (Sec. 36 T16S R13E)
e) Length	14 miles
Routing	Parallel to existing Vail - South Line
Purpose	To reinforce TEP's EHV system and to provide additional transmission capacity between Vail and South Substations
Date	
a) Construction Start	TBD
b) In-Service Date	TBD
Is Certificate Necessary	No
Technical Studies	Studies in progress via SWAT, SATS and internal TEP study efforts.

TUCSON ELECTRIC POWER COMPANY

10 YEAR PLAN

TRANSMISSION FACILITIES

Line Designation	Springerville Substation to Greenlee Substation - 2 nd circuit
Size	
a) Voltage	345-kV
b) Capacity	System dependent
c) Point of Origin	Springerville Substation (Sec. 34 T11N R30E)
d) Point of Termination	Greenlee Substation (Sec. 29 T5S R31E)
e) Length	110 Miles total; 27 Miles in Arizona.
Routing	Parallel to existing Springerville to Greenlee line.
Purpose	To deliver power and energy from major TEP interconnections in the Four Corners and Eastern Arizona regions.
Date	
a) Construction Start	TBD
b) In-Service Date	TBD
Is Certificate Necessary	Case numbers 12, 30, 63 and 73
Technical Studies	Studies conducted in coordination with neighboring utilities formed the basis for the design of TEP's original EHV system in the 70's. This project is based on that original work. Detailed studies will be developed in the future upon a determination of need for this project by TEP.

TUCSON ELECTRIC POWER COMPANY

10 YEAR PLAN

TRANSMISSION FACILITIES

Line Designation	Tortolita Substation to South Substation.
Size	
a) Voltage	345-kV
b) Capacity	System dependent
c) Point of Origin	Tortolita Substation (Sec. 23 T10S R10E)
d) Point of Termination	South Substation (Sec. 36 T16S R13E)
e) Length	68 Miles
Routing	From Tortolita Substation south through Avra Valley to existing Westwing-South 345-kV transmission line right-of-way, then parallel to existing Westwing - South line to South Substation.
Purpose	To reinforce TEP's EHV system and to provide a high capacity link for the flow of power in Southern Arizona.
Date	
a) Construction Start	TBD
b) In-Service Date	TBD
Is Certificate Necessary	Case Number 50
Technical Studies	Studies conducted in coordination with neighboring utilities formed the basis for the design of TEP's original EHV system in the 70's. This project is based on that original work. Detailed studies will be developed in the future upon a determination of need for this project by TEP.

TUCSON ELECTRIC POWER COMPANY

10 YEAR PLAN

TRANSMISSION FACILITIES

Line Designation	Westwing Substation to South Substation - 2 nd circuit
Size	
a) Voltage	345-kV
b) Capacity	System dependent
c) Point of Origin	Westwing Substation (Sec. 12 T4N R1W)
d) Point of Termination	South Substation (Sec. 36 T16S R13E)
e) Length	178 Miles
Routing	Parallel to existing Westwing to South line.
Purpose	To deliver power and energy from major TEP interconnections in the Northwest Phoenix region.
Date	
a) Construction Start	TBD
b) In-Service Date	TBD
Is Certificate Necessary	Case Number 15
Technical Studies	Studies conducted in coordination with neighboring utilities formed the basis for the design of TEP's original EHV system in the 70's. This project is based on that original work. Detailed studies will be developed in the future upon a determination of need for this project by TEP. To be reviewed in SWAT, SATS and internal TEP studies.

TUCSON ELECTRIC POWER COMPANY

10 YEAR PLAN

TRANSMISSION FACILITIES

Line Designation	TEP-UNS Electric 345 kV Interconnection -- South Substation to future Gateway Substation (2 ckts.)
Size	
a) Voltage	345-kV
b) Capacity	500 MW
c) Point of Origin	South Substation (Sec. 36 T16S R13E)
d) Points of Termination	Gateway Substation in (Sec. 12 T24S R13E)
e) Length	Approximately 60 Miles
Routing	Southerly from South Substation, near Sahuarita Arizona to Nogales area.
Purpose	To provide an alternate transmission path to UNS Electric in Nogales, Arizona pursuant to ACC Order.
Date	
a) Construction Start	Dependent upon permitting
b) In-Service Date	Dependent upon permitting
Is Certificate Necessary	Case Number 111
Technical Studies	See record of Siting Case Number 111

TUCSON ELECTRIC POWER COMPANY

10 YEAR PLAN

TRANSMISSION FACILITIES

Line Designation	Gateway Substation to Comision Federal de Electricidad (CFE) (2 cks.)
Size	
a) Voltage	345-kV
b) Capacity	500 MW
c) Point of Origin	Gateway Substation (Sec. 12 T24S R13E)
d) Points of Termination	Arizona-Sonora boundary (Sec. 13 T24S R13E)
e) Length	Approximately 2 Miles
Routing	Southerly from Gateway Substation, in or near the Nogales area.
Purpose	To interconnect to the Comision Federal de Electricidad in Sonora, Mexico.
Date	
a) Construction Start	Dependent upon permitting
b) In-Service Date	Dependent upon permitting
Is Certificate Necessary	Case Number 111
Technical Studies	See record of Siting Case Number 111

TUCSON ELECTRIC POWER COMPANY

10 YEAR PLAN

TRANSMISSION FACILITIES

Line Designation	SunZia Southwest Transmission 500kV Project
Size	
a) Voltage	500-kV
b) Capacity	Approximately 3000 MVA
c) Point of Origin	Central New Mexico
d) Point of Termination	Proposed Pinal Central Substation
e) Length	Approximately 460+ miles
Routing	From Lincoln County area in central New Mexico to Pinal Central Substation in Coolidge, Arizona.
Purpose	Provide TEP and participants access to anticipated renewable generation resources in Southeastern Arizona and New Mexico.
Date	
a) Construction Start	TBD
b) In-Service Date	2015/2016
Is Certificate Necessary	Yes
Technical Studies	Studies in progress

TUCSON ELECTRIC POWER COMPANY

10 YEAR PLAN

TRANSMISSION FACILITIES

Line Designation	Series Capacitor Replacement at Vail 345kV Substation (Winchester - Vail 345kV Line)
Size	
a) Voltage	345-kV
b) Capacity	1195 MW Continuous/1494 MW Emergency
c) Point of Origin	Vail Substation
d) Point of Termination	Vail Substation
e) Length	NA
Routing	NA
Purpose	To increase the Winchester - Vail 345kV facility rating and mitigate maintenance issues.
Date	
a) Construction Start	2014
b) In-Service Date	2015
Is Certificate Necessary	No
Technical Studies	Completed

TUCSON ELECTRIC POWER COMPANY

10 YEAR PLAN

TRANSMISSION FACILITIES

Line Designation	Series Capacitor Replacement at Vail 345kV Substation (Springerville - Vail 345kV Line)
Size	
a) Voltage	345-kV
b) Capacity	1195 MW Continuous/1494 MW Emergency
c) Point of Origin	Vail Substation
d) Point of Termination	Vail Substation
e) Length	NA
Routing	NA
Purpose	To increase the Winchester - Vail 345kV facility rating and mitigate maintenance issues.
Date	
a) Construction Start	2012
b) In-Service Date	2013
Is Certificate Necessary	No
Technical Studies	Completed

TUCSON ELECTRIC POWER COMPANY

10 YEAR PLAN

TRANSMISSION FACILITIES

Line Designation	McKinley 345kV Substation Reactor Addition
Size	
a) Voltage	345-kV
b) Capacity	60 MVAR
c) Point of Origin	McKinley Substation
d) Point of Termination	McKinley Substation
e) Length	NA
Routing	NA
Purpose	To mitigate high voltages at McKinley during low flow conditions.
Date	
a) Construction Start	2011
b) In-Service Date	2011
Is Certificate Necessary	No
Technical Studies	Completed

TUCSON ELECTRIC POWER COMPANY

10 YEAR PLAN

TRANSMISSION FACILITIES

Line Designation	Tortolita 500/138kV Transformer T3
Size	
a) Voltage	500/138-kV
b) Capacity	672 MVA Continuous/940 MVA Emergency
c) Point of Origin	Tortolita 500kV Bus
d) Point of Termination	Tortolita 138kv Bus
e) Length	NA
Routing	NA
Purpose	To increase TEP load serving capability.
Date	
a) Construction Start	2010
b) In-Service Date	2011
Is Certificate Necessary	No
Technical Studies	Completed

TUCSON ELECTRIC POWER COMPANY

10 YEAR PLAN

TRANSMISSION FACILITIES

Line Designation	Vail 345/138kV Transformer T3
Size	
a) Voltage	345/138-kV
b) Capacity	672/806 MVA
c) Point of Origin	Vail 500kV Bus
d) Point of Termination	Vail 138kv Bus
e) Length	NA
Routing	NA
Purpose	To increase TEP load serving capability and provide delivery point to UNSE.
Date	
a) Construction Start	2011
b) In-Service Date	2012
Is Certificate Necessary	No
Technical Studies	Completed

TUCSON ELECTRIC POWER COMPANY

10 YEAR PLAN

TRANSMISSION FACILITIES

Line Designation	Vail 345/138kV Transformer T4
Size	
a) Voltage	345/138-kV
b) Capacity	672/806 MVA
c) Point of Origin	Vail 345kV Bus
d) Point of Termination	Vail 138kv Bus
e) Length	NA
Routing	NA
Purpose	To increase TEP load serving capability.
Date	
a) Construction Start	TBD
b) In-Service Date	TBD
Is Certificate Necessary	No
Technical Studies	In Progress

HV Plans

The TEP 138kV existing and planned local area transmission system is shown in Figure 3. *TEP Local Area 138kV Ten Year Transmission Plan*. Existing substations and lines are shown as green blocks and solid black lines respectively. Proposed substations are shown as yellow blocks and proposed lines are in red. Reconductor projects are shown in subdued red.

Tucson Electric Power Company 2011 – 2020 Ten-Year Transmission Plan Local Transmission System Single Line

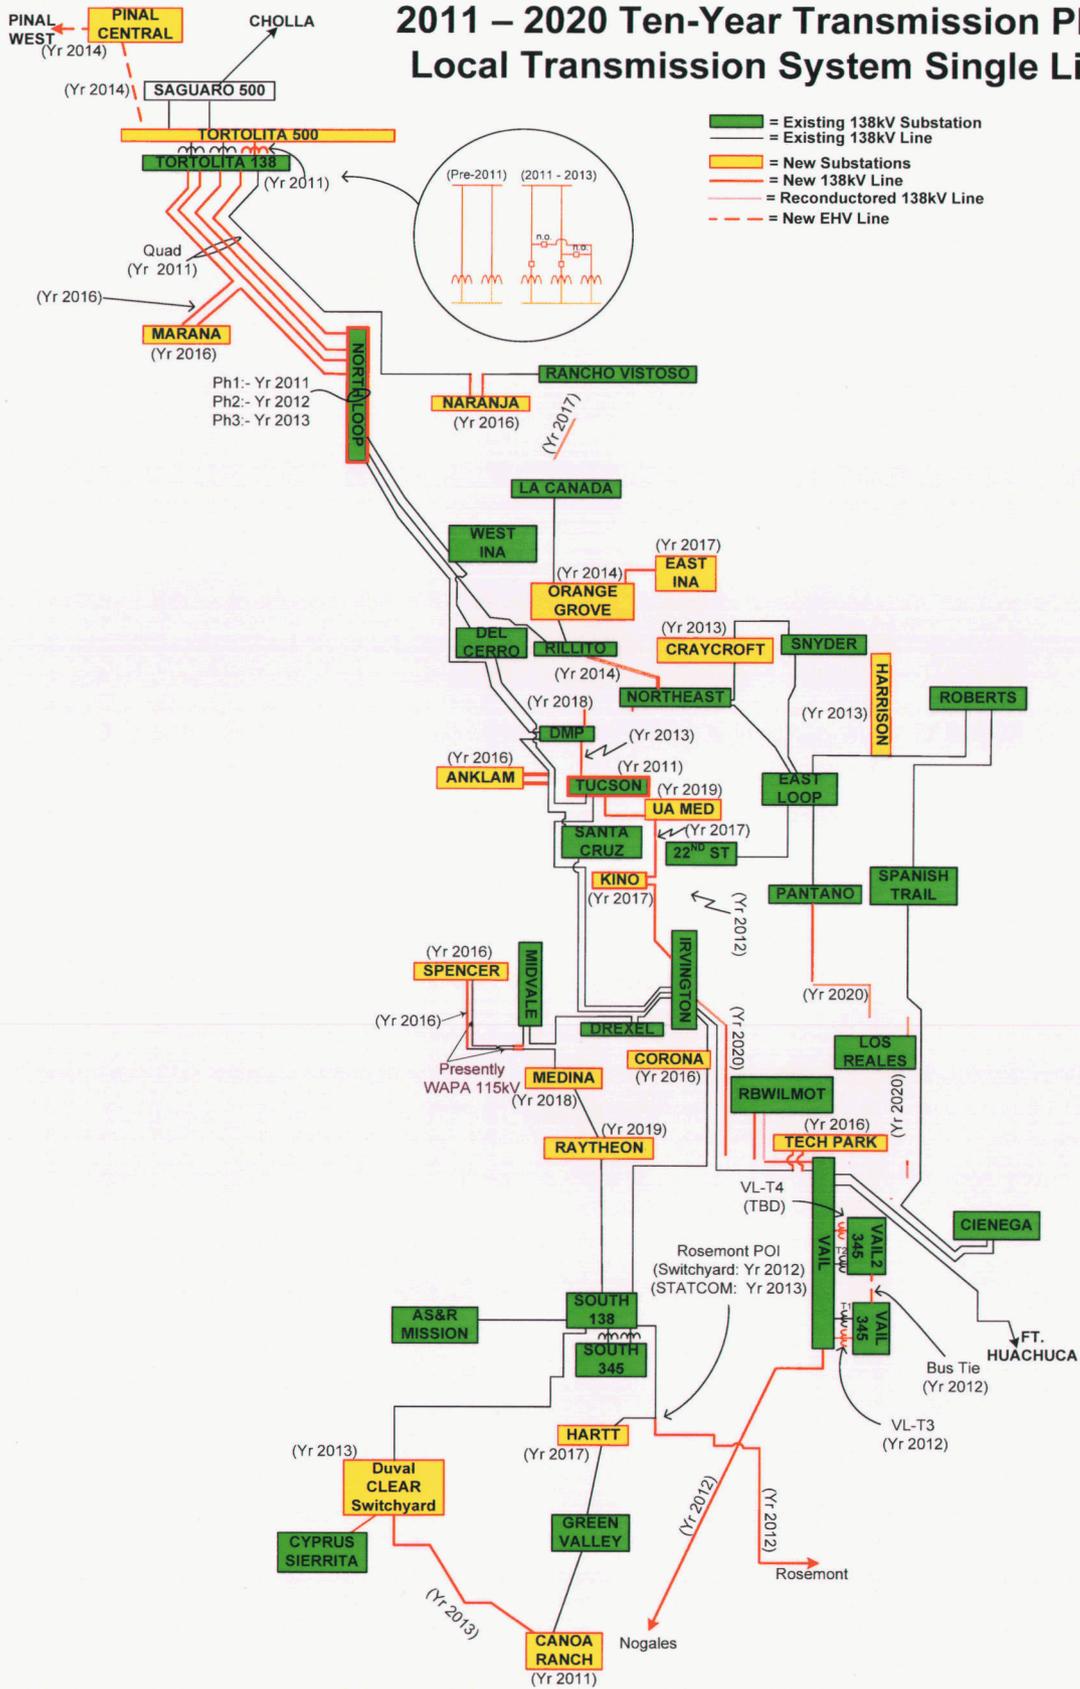


Figure 3. TEP Local Area 138kV Ten Year Transmission Plan

TUCSON ELECTRIC POWER COMPANY

10 YEAR PLAN

TRANSMISSION FACILITIES

Line Designation	Irvington Substation to East Loop Substation (through 22nd Street Substation).	
Size		
a) Voltage	138-kV	
b) Capacity	System dependent	
c) Point of Origin	Irvington Substation (Sec. 03 T15S R14E)	
d) Point of Termination	East Loop Substation (Sec. 08 T14S R15E)	
e) Length	Irvington - East Loop - 9 Miles	
	Phase 1: Irvington Station to 22 nd Street Substation - 4 miles	
	Phase 2: 22 nd Street to East Loop Substation - 5 miles	
Routing	North and East of Irvington Substation, through 22nd Street Substation, then East and North to East Loop Substation.	
Purpose	To provide additional electric service to the central area of TEP's service area and to reinforce the local transmission system.	
Date		
a) Construction Start	1985	
b) In-Service Date	Phase 1 - 1994 (Completed)	Irvington Station to 22nd St. Substation
	Phase 2 - 2000 (Completed)	22nd Street to East Loop Substation
	Phase 3 - TBD	2nd Circuit of Phase I
Is Certificate Necessary	Case Number 66	

TUCSON ELECTRIC POWER COMPANY

10 YEAR PLAN

TRANSMISSION FACILITIES

Line Designation	Vail Substation to East Loop Substation through Spanish Trail and Roberts Substations, tapping the Roberts-East Loop line for new Harrison Substation.	
Size		
a) Voltage	138-kV	
b) Capacity	System dependent	
c) Point of Origin	Vail Substation (Sec. 4 T16S R15E)	
d) Point of Termination	East Loop Substation (Sec. 8 T14S R15E)	
e) Length	Phase 1: Vail Substation to East Loop Substation - 22 Miles Phase 2: East Loop - Roberts - 7 miles Spanish Trail to Roberts - 5.75 miles Phase 3: Vail Substation to East Loop Substation - 22 Miles Phase 4: East Loop - Harrison - approximately 3 miles Roberts - Harrison - approximately 4 miles	
Routing	East and north from Vail Substation along existing transmission line to Irvington and Houghton Roads, then north along Houghton Road to Speedway Boulevard, then east and north to Roberts Substation and west along Speedway to East Loop Substation.	
Purpose	To provide additional electric service to the eastern portion of TEP's service area and to reinforce the local transmission system.	
Date		
a) Construction Start	1976	
b) In-Service Date	Phase 1 - 1977 (Completed)	Spanish Trail Substation to East Loop and Vail Substation

Is Certificate Necessary

Phase 2 - 1983
(Completed)

Roberts Substation
and associated 138-
kV lines

Phase 3 -
TBD

Third 138-kV line
from Vail to East
Loop Substation

Phase 4 - 2013

Harrison Substation
tap of Roberts-East
Loop 138 kV line

Case Number 8

TUCSON ELECTRIC POWER COMPANY
 10 YEAR PLAN
 TRANSMISSION FACILITIES

Line Designation	Interconnection of South - Midvale 138 kV circuit with future Spencer, Raytheon, Medina 138kV substations
a) Voltage	138-kV
b) Capacity	System dependent
c) Point of Origin	Midvale 138 kV Substation
d) Interim Points	Phase 1: Future Spencer Substation (Sec. 2 T15S R12E) Phase 2: Future Medina 138kV Substation Phase 3 : Future Raytheon 138 kV Substation
e) Termination Point	South 138kV Substation
f) Length	Phase 1: Midvale-Spencer, approximately 8 miles of double-circuit 138 kV Phase 2: Spencer - Medina - approximately 5 miles Medina - South - approximately 11 miles Phase 3: Medina - Raytheon - approximately 3 miles Raytheon - South - approximately 8 miles
Routing	Phase 1: West of Midvale Substation along Valencia Road, then north on Spencer Road alignment. Phase 2: Medina Substation will be adjacent to existing Midvale - South 138kV circuit

	Phase 3: Raytheon Substation will be adjacent to existing Midvale - South 138kV circuit
Purpose	Phase 1: To provide additional electrical service to the far western portion of TEP's service area and to reinforce the local distribution system. Phase 2: Required to serve load at the new Medina 138 kV Substation Phase 3: Required to serve load at the new Raytheon 138 kV Substation
Date	
a) Construction Start	Phase 1: 2015 Phase 2: 2017 Phase 3: 2018
b) In-Service Date	Phase 1: 2016 Phase 2: 2018 Phase 3: 2019
Is Certificate Necessary	Phase 1: TBD (dependent upon use of Federal and/or Tohono r/w) Phase 2: No Phase 3: No

TUCSON ELECTRIC POWER COMPANY

10 YEAR PLAN

TRANSMISSION FACILITIES

Line Designation	South Substation to Duval CLEAR Switchyard through future Canoa Ranch Substation and Green Valley Substation	
Size		
a) Voltage	138-kV	
b) Capacity	System dependent	
c) Point of Origin	South Substation (Sec. 36 T16S R13E)	
d) Point of Termination	Duval CLEAR Switchyard (Sec. 10 T18S R12E)	
e) Length	South - Green Valley - Approximately 15 miles	
	Green Valley - Canoa Ranch - Approximately 3.5 miles	
	Canoa Ranch - Duval CLEAR Switchyard - Approximately 7.5 miles	
Routing	Uses existing transmission, sub-transmission, and overhead distribution route.	
Purpose	To provide additional electrical service to southern area of TEP's service area and to reinforce the local transmission & distribution system.	
Date		
a) Construction Start	1995	
b) In-Service Date	Phase 1 -1997 (Completed)	South 138-kV line to Green Valley.
	Phase 2a -2006 (Completed)	138-kV line from Green Valley to future Canoa Ranch Substation site

Phase 2b- 2013

Extend 138-kV line
from Canoa Ranch
Substation site to
future Duval CLEAR
Switchyard

Is Certificate Necessary

Case 84

(Extension approved in 2006 Commission
Decision No. 69680(June 28, 2007)

TUCSON ELECTRIC POWER COMPANY

10 YEAR PLAN

TRANSMISSION FACILITIES

Line Designation	Rancho Vistoso Substation to future Sun City Substation
Size	
a) Voltage	138-kV
b) Capacity	System dependent
c) Point of Origin	Rancho Vistoso Substation (Sec. 36 T11S R13E)
d) Point of Termination	Future Sun City Substation (Sec. 18 T11S R14E)
e) Length	Approximately 3.5 Miles
Routing	Existing Western Area Power Administration corridor
Purpose	To provide additional electrical service to far northern area of TEP's service area and to reinforce the local distribution system.
Date	
a) Construction Start	TBD
b) In-Service Date	TBD
Is Certificate Necessary	No

TUCSON ELECTRIC POWER COMPANY

10 YEAR PLAN

TRANSMISSION FACILITIES

Line Designation	Loop existing Irvington Station to Vail Substation #2 line through future University of Arizona Tech Park Substation.
Size	
a) Voltage	138-kV
b) Capacity	System dependent
c) Point of Origin	Vail - Irvington Corridor
d) Point of Termination	Future U of A Tech Park Substation approximately (Sec. 28 T15S R15E)
e) Length	Approximately 2 miles of double-circuited line
Routing	Loop existing Irvington - Vail #2 line into future U of A Tech Park substation
Purpose	To provide additional electric service to the U of A Tech Park expansion and the southern part of TEP's service area.
Date	
a) Construction Start	2015
b) In-Service Date	2016
Is Certificate Necessary	Yes

TUCSON ELECTRIC POWER COMPANY

10 YEAR PLAN

TRANSMISSION FACILITIES

Line Designation	Tortolita Substation – North Loop Substation, North Loop Substation – Rancho Vistoso Substation and Tortolita – Rancho Vistoso 138 kV corridor expansion and reconfiguration
Size	
a) Voltage	138-kV
b) Capacity	System dependent
c) Points of Origin	Tortolita 138 kV Substation North Loop 138 kV Substation
d) Points of Termination	North Loop 138 kV Substation Rancho Vistoso 138 kV Substation
e) Length	Tortolita – North Loop – approximately 14 miles North Loop – Rancho Vistoso – approximately 11 miles
Routing	<p>Phase 1: Re-configure Tortolita – Rancho Vistoso line as a third Tortolita - North Loop line utilizing existing 138 kV stub out of North Loop. Build new bay at North Loop to accommodate North Loop – Rancho Vistoso line utilizing existing 138 kV pole-line along Tangerine Rd.</p> <p>Phase 2: A new four-circuit pole-line to replace existing single-circuit structures in the Tortolita-North Loop 138 kV corridor. The four-circuit structures will accommodate the two existing Tortolita-North Loop lines, and two new Tortolita – North Loop lines This phase also includes reconfiguring the Tortolita – North Loop #3 and North Loop – Rancho Vistoso 138 kV lines as Tortolita – Rancho Vistoso 138 kV. This was previously a jointly planned</p>

project between SWTC and TEP but is now solely TEP.

Purpose

Required to meet reliability criteria.

Date

a) Construction Start

2008

b) In-Service Date

Phase 1: 2008- Completed

Phase 2: 2011

Is Certificate Necessary

Phase 1: No

Phase 2: Case Number 149

TUCSON ELECTRIC POWER COMPANY

10 YEAR PLAN

TRANSMISSION FACILITIES

Line Designation	Vail Substation - Cienega Substation - Spanish Trail Substation 138 kV
Size	
a) Voltage	138-kV
b) Capacity	System dependent
c) Point of Origin	Vail 138 kV Substation
d) Interim Point	Future Cienega 138kV Substation (Sec 16 T16S R16E)
e) Point of Termination	Spanish Trail 138 kV Substation
f) Length	Approximately 12 miles
Routing	Utilize the existing Vail-Fort Huachuca/ Vail-Spanish Trail 138 kV corridor between Vail Substation and seven spans east of Wentworth Rd., then new double-circuit 138 kV northeast approximately 2 miles to proposed Cienega site.
Purpose	Required to serve load at the new Cienega 138/13.8 kV Substation located approximately 7.5 miles east-southeast of the Vail Substation.
Date	a) Construction Start 2009 b) In-Service Date 2010 - Completed
Is Certificate Necessary	Case number 137

TUCSON ELECTRIC POWER COMPANY

10 YEAR PLAN

TRANSMISSION FACILITIES

Line Designation	Northeast - Snyder 138kV - tap for Craycroft-Barril Substation
Size	
a) Voltage	138-kV
b) Capacity	System dependent
c) Point of Origin	Northeast 138 kV Substation
d) Interim Point	Future Craycroft-Barril 138kV Substation
e) Point of Termination	Snyder 138 kV Substation
f) Length	Northeast - Craycroft-Barril - approximately 8 miles Snyder - Craycroft-Barril - approximately 4 miles
Routing	Existing Northeast-Snyder Corridor requires 1 span of wire to drop into station.
Purpose	Required to serve load at the new Craycroft-Barril 138/13.8 kV Substation located approximately 3 miles northeast of the Northeast Substation
Date	
a) Construction Start	2012
b) In-Service Date	2013
Is Certificate Necessary	No

TUCSON ELECTRIC POWER COMPANY

10 YEAR PLAN

TRANSMISSION FACILITIES

Line Designation	Interconnection of Tortolita - North Loop 138 kV with future TEP Marana 138 kV Substation
Size	
a) Voltage	138-kV
b) Capacity	System dependent
c) Point of Origin	Tortolita 138 kV Substation
d) Interim Point	Future Marana 138kV Substation
e) Point of Termination	North Loop 138 kV Substation
f) Length	Tortolita-Marana-North Loop - approximately 22 miles Tortolita - Marana - approximately 13 miles Marana - North Loop - approximately 9 miles
Routing	Tap the Tortolita- North Loop corridor at the Trico-Marana Rd. alignment and extend approximately 4 miles of double-circuit pole-line west across I-10 to proposed Marana substation site near Sanders Rd.
Purpose	Required to serve load at the new Marana 138/13.8 kV Substation located approximately 9 miles south-southeast of the Tortolita Substation
Date	
	a) Construction Start 2015
	b) In-Service Date 2016
Is Certificate Necessary	Yes

TUCSON ELECTRIC POWER COMPANY

10 YEAR PLAN

TRANSMISSION FACILITIES

Line Designation	Tortolita Substation - Rancho Vistoso Substation 138kV tap for new Naranja Substation
Size	
a) Voltage	138-kV
b) Capacity	System dependent
c) Point of Origin	Tortolita 138 kV Substation
d) Interim Point	Future Naranja 138 kV Substation
e) Point of Termination	Ranch Vistoso 138 kV Substation
f) Length	Tortolita - Naranja - approximately 22 miles Naranja - Ranch Vistoso - approximately 17 miles
Routing	Tap the Tortolita - Rancho Vistoso line and extend approximately 3 miles of new double circuit pole-line south of Tangergine Rd. along Thornydale Rd. to the substation site
Purpose	Required to serve load at the new Naranja 138/13.8 kV Substation located in the vicinity of Thornydale Rd. and Lambert Ln.
Date	
a) Construction Start	2015
b) In-Service Date	2016
Is Certificate Necessary	Yes

TUCSON ELECTRIC POWER COMPANY

10 YEAR PLAN

TRANSMISSION FACILITIES

Line Designation	DeMoss Petrie Substation - Tucson Station 138 kV
Size	
a) Voltage	138-kV
b) Capacity	System dependent
c) Point of Origin	DeMoss Petrie 138 kV Substation
d) Point of Termination	Tucson 138 kV Substation
e) Length	2.2 miles
Routing	Unknown
Purpose	Required to meet reliability criteria of a localized voltage instability specific to loss of both the North Loop-West Ina and Irvington-Tucson 138 kV circuits.
Date	
a) Construction Start	2012
b) In-Service Date	2013
Is Certificate Necessary	Yes

TUCSON ELECTRIC POWER COMPANY

10 YEAR PLAN

TRANSMISSION FACILITIES

Line Designation	Irvington Substation – Corona Substation – South Substation 138kV
Size	
a) Voltage	138-kV
b) Capacity	System dependent
c) Point of Origin	Irvington 138 kV Substation
d) Interim Point	Future Corona 138 kV Substation
e) Point of Termination	South 138kV Substation
f) Length	Irvington – Corona – approximately 16 miles Corona – South – approximately 4 miles
Routing	Tapping the existing Irvington – South 138kV circuit.
Purpose	Required to serve load at the new Corona 138/13.8 kV Substation
Date	a) Construction Start 2015 b) In-Service Date 2016
Is Certificate Necessary	TBD

TUCSON ELECTRIC POWER COMPANY

10 YEAR PLAN

TRANSMISSION FACILITIES

Line Designation	La Canada Substation - Orange Grove Substation- Rillito Substation 138kV
Size	
a) Voltage	138-kV
b) Capacity	System dependent
c) Point of Origin	La Canada 138 kV Substation
d) Interim Point	Future Orange Grove 138 kV Substation
e) Point of Termination	Rillito 138kV Substation
f) Length	La Canada - Orange Grove - approximately 4 miles Orange Grove - Rillito - approximately 2 miles
Routing	Tapping the existing La Canada - Rillito 138kV circuit and drop into new station adjacent to the right-of-way at La Canada Blvd. and Orange Grove Rd.
Purpose	Required to serve load at the new Orange Grove 138/13.8 kV Substation
Date	
a) Construction Start	2013
b) In-Service Date	2014
Is Certificate Necessary	TBD

TUCSON ELECTRIC POWER COMPANY

10 YEAR PLAN

TRANSMISSION FACILITIES

Line Designation	Future Orange Grove Substation - Future East Ina Substation 138kV
Size	
a) Voltage	138-kV
b) Capacity	System dependent
c) Point of Origin	Future Orange Grove 138 kV Substation
d) Point of Termination	Future East Ina 138kV Substation
e) Length	Approximately 4 miles
Routing	Unknown
Purpose	Required to serve load at the new East Ina 138/13.8 kV Substation
Date	
a) Construction Start	2016
b) In-Service Date	2017
Is Certificate Necessary	Yes

TUCSON ELECTRIC POWER COMPANY

10 YEAR PLAN

TRANSMISSION FACILITIES

Line Designation	South Substation - Hartt Substation- Green Valley Substation 138kV
Size	
a) Voltage	138-kV
b) Capacity	System dependent
c) Point of Origin	South 138 kV Substation
d) Interim Point	Future Hartt 138 kV Substation
e) Point of Termination	Green Valley 138kV Substation
f) Length	South - Hartt - approximately 11 miles Hartt - Green Valley - approximately 4 miles
Routing	Looping the existing South - Green Valley 138kV circuit and drop into new station adjacent to the right-of-way approximately 1 mile south of Old Nogales Hwy and Duval Mine Rd.
Purpose	Increase load serving and reliability of existing 46/13.8 facilities near this site.
Date	
a) Construction Start	2016
b) In-Service Date	2017
Is Certificate Necessary	No

TUCSON ELECTRIC POWER COMPANY

10 YEAR PLAN

TRANSMISSION FACILITIES

Line Designation	Del Cerro Substation – Anklam Substation – Tucson Station 138kV
Size	
a) Voltage	138-kV
b) Capacity	System dependent
c) Point of Origin	Del Cerro 138 kV Substation
d) Interim Point	Future Anklam 138 kV Substation
d) Point of Termination	Tucson 138kV Substation
e) Length	Del Cerro – Anklam – approximately 5 miles Anklam – Tucson – approximately 3 miles
Routing	Anklam to tie into the existing Del Cerro – Tucson 138kV circuit with approximately two mile extension of double circuit 138 kV pole-line.
Purpose	Required to serve load at the new Anklam 138/13.8 kV Substation
Date	
a) Construction Start	2015
b) In-Service Date	2016
Is Certificate Necessary	Yes

TUCSON ELECTRIC POWER COMPANY

10 YEAR PLAN

TRANSMISSION FACILITIES

Line Designation	Rosemont Point of Interconnection to Rosemont Substation 138 kV
Size	
a) Voltage	138-kV
b) Capacity	> 120 MVA
c) Point of Origin	Rosemont Point of Interconnection that will tap the TEP South - Green Valley 138 kV Line
d) Point of Termination	Future Rosemont Substation (approximately Sec. 6 T19S R16E)
e) Length	Approximately 24 Miles
Routing	Currently being analyzed for submission of CEC application.
Purpose	To provide electrical service to large mine load located ~ 17 miles east-southeast of Green Valley, AZ
Date	
a) Construction Start	2011
b) In-Service Date	2012
Is Certificate Necessary	Yes

TUCSON ELECTRIC POWER COMPANY

10 YEAR PLAN

TRANSMISSION FACILITIES

Line Designation	Irvington Substation -Tucson Station #2 138 kV	
Size		
a) Voltage	138-kV	
b) Capacity	System Dependent	
c) Point of Origin	Irvington Substation	
d) Interim Point	New Kino Substation	
e) Interim Point	New UA Med Substation	
f) Point of Termination	Tucson Station	
g) Length	Phase 1: Irvington - Kino - approximately 6 miles Kino - Tucson - approximately 5 miles Phase 2: Kino - UA Med - approximately 6 miles UA Med - Tucson - approximately 3 miles	
Routing	Unknown	
Purpose	To increase load serving capability and reliability in Central Tucson.	
Date		
a) Construction Start	2016	
b) In-Service Date	Phase 1 - 2017	Irvington Substation to new Kino Substation to

		Tucson Station 138 kV lines
	Phase 2 - 2019	Loop Kino Substation to Tucson Station Substation 138-kV line into UA Med Substation
Is Certificate Necessary	Yes	

TUCSON ELECTRIC POWER COMPANY

10 YEAR PLAN

TRANSMISSION FACILITIES

Line Designation	Rancho Vistoso - La Canada 138kV Line Reconductor
Size	
a) Voltage	138-kV
b) Capacity	System Dependent
c) Point of Origin	Rancho Vistoso Substation
d) Point of Termination	La Canada Substation
e) Length	Approximately 4.5 Miles
Routing	Existing
Purpose	To increase TEP load serving capability.
Date	
a) Construction Start	2016
b) In-Service Date	2017
Is Certificate Necessary	No

TUCSON ELECTRIC POWER COMPANY

10 YEAR PLAN

TRANSMISSION FACILITIES

Line Designation	Los Reales - Vail 138kV Line Reconductor
Size	
a) Voltage	138-kV
b) Capacity	System Dependent
c) Point of Origin	Los Reales Substation
d) Point of Termination	Vail Substation
e) Length	Approximately 8 Miles
Routing	Existing
Purpose	To increase TEP load serving capability.
Date	
a) Construction Start	2019
b) In-Service Date	2020
Is Certificate Necessary	No

TUCSON ELECTRIC POWER COMPANY

10 YEAR PLAN

TRANSMISSION FACILITIES

Line Designation	North East Loop - Rillito 138kV Line Reconductor
Size	
a) Voltage	138-kV
b) Capacity	System Dependent
c) Point of Origin	North East Loop Substation
d) Point of Termination	Rillito Substation
e) Length	Approximately 5 Miles
Routing	Existing
Purpose	To increase TEP load serving capability.
Date	
a) Construction Start	2013
b) In-Service Date	2014
Is Certificate Necessary	No

TUCSON ELECTRIC POWER COMPANY

10 YEAR PLAN

TRANSMISSION FACILITIES

Line Designation	Irvington - Robert Bills-Wilmot 138kV Line Reconductor
Size	
a) Voltage	138-kV
b) Capacity	System Dependent
c) Point of Origin	Irvington Substation
d) Point of Termination	Robert Bills-Wilmot Substation
e) Length	Approximately 11 Miles
Routing	Existing
Purpose	To increase TEP load serving capability.
Date	
a) Construction Start	2019
b) In-Service Date	2020
Is Certificate Necessary	No

TUCSON ELECTRIC POWER COMPANY

10 YEAR PLAN

TRANSMISSION FACILITIES

Line Designation	Los Reales - Pantano 138kV Line Reconductor
Size	
a) Voltage	138-kV
b) Capacity	System Dependent
c) Point of Origin	Los Reales Substation
d) Point of Termination	Pantano Substation
e) Length	Approximately 9 Miles
Routing	Existing
Purpose	To increase TEP load serving capability.
Date	
a) Construction Start	2019
b) In-Service Date	2020
Is Certificate Necessary	No

TUCSON ELECTRIC POWER COMPANY

10 YEAR PLAN

TRANSMISSION FACILITIES

Line Designation	DeMoss Petrie – North East Loop 138kV Line Reconductor
Size	
a) Voltage	138-kV
b) Capacity	System Dependent
c) Point of Origin	DeMoss Petrie Substation
d) Point of Termination	North East Substation
e) Length	Approximately 6 Miles
Routing	Existing
Purpose	To increase TEP load serving capability.
Date	
a) Construction Start	2017
b) In-Service Date	2018
Is Certificate Necessary	No

TUCSON ELECTRIC POWER COMPANY

10 YEAR PLAN

TRANSMISSION FACILITIES

Line Designation	North Loop – Rillito 138kV Line Reconductor
Size	
a) Voltage	138-kV
b) Capacity	System Dependent
c) Point of Origin	North Loop Substation
d) Point of Termination	Rillito Substation
e) Length	Approximately 11 Miles
Routing	Existing
Purpose	To increase TEP load serving capability.
Date	
a) Construction Start	2016
b) In-Service Date	2017
Is Certificate Necessary	No

TUCSON ELECTRIC POWER COMPANY

10 YEAR PLAN

TRANSMISSION FACILITIES

Line Designation	Rosemont Point of Interconnection STATCOM
Size	
a) Voltage	138-kV
b) Capacity	50-75 MVA _r
c) Point of Origin	Rosemont Point of Interconnection Switchyard
d) Point of Termination	Rosemont Point of Interconnection Switchyard
e) Length	NA
Routing	To be located in Rosemont Point of interconnection Switchyard.
Purpose	To provide voltage support for post- contingency conditions following interconnection of the Rosemont Mine load to the TEP 138 kV system and completion of the loop of the Green Valley 138 kV system.
Date	
a) Construction Start	2013
b) In-Service Date	2013
Is Certificate Necessary	No

TEP EHV Transmission Line Ratings - 2010
(Series Caps In-Service)

LINE NOTATION						CIRCUIT RATING				Limiting Element
S1 ID	series cap		S2 ID	Ckt	LENGTH (MI)	CONTINUOUS		EMERGENCY		All Series Caps In-Service
	ID	bypassed? (1)				MVA	AMP	MVA	AMP	
SJ			MK	1	90	777	1300	1016	1700	Series Capacitor
	SC	NO								
SJ			MK	2	90	777	1300	956	1600	Series Capacitor & Relay Thermal Limit
	SC	NO								
MC			SP	1	107	925	1548	1110	1858	CT Thermal Limit
MC			SP	2	107	925	1548	1110	1858	CT Thermal Limit
SP			CO	1	22	755	1264	765	1280	CT Thermal Limit & Relay Thermal Limit
SP			GL	1	110	745	1247	1010	1690	Series Capacitor
	SC	NO								
SP			VL	1	110	666	1115	717	1200	Series Capacitor & Relay Thermal Limit
	SC1	NO								
	SC2	NO								
					0					
GL			WN	1	88	925	1548	1110	1858	CT Thermal Limit
WN			VL	1	41	896	1500	1110	1858	Series Capacitor & Relay Thermal Limit
	SC	NO								
VL			SO	1	14	925	1548	956	1600	CT Thermal Limit & Relay Thermal Limit
WW			PW	1	60	925	1548	1076	1800	CT Thermal Limit & Relay Thermal Limit
PW			SO	1	118	925	1548	1110	1858	CT Thermal Limit
SA			TO	1	1	1039	1200	1247	1440	CT Thermal Limit
SA			TO	2	1	1039	1200	1247	1440	CT Thermal Limit

Attachments

TEP 138 kV Transmission Line Ratings - 2010

LINE #	LINE NOTATION				CIRCUIT RATING (MVA)				LIMITING ELEMENT
	S1	S2	Ckt	LINE WIRE SIZE MCM	CONTINUOUS		EMERGENCY		
					MVA	AMP	MVA	AMP	
101	IR	RB	1	795 ACSR Drake	382	1600	382	1600	Breaker
102	IR	VL	2	795 ACSR Drake	418	1749	418	1749	Conductor
103	VL	CI	1	795ACSR Drake	406	1699	406	1699	Conductor
				1365 ACAR					
104	VL	FH	1	795ACSR Drake	418	1749	418	1749	Conductor
				954 ACSS 45/7 Rail					
105	IR	SO	1	795 ACSR Drake	370	1547	370	1547	Conductor
106	SO	ASR	1	795 ACSR Drake	348	1455	348	1455	Conductor
107	SO	CYP	1	795 ACSR Drake	418	1749	418	1749	Conductor
108	VL	LR	1	1365 ACAR	406	1699	406	1699	Conductor
109	SO	MV	1	795 ACSR Drake	311	1301	311	1301	Conductor
110	DP	NL	1	795 ACSR Drake	382	1600	382	1600	Breaker
111	IR	TU	1	795 ACSR Drake	347	1452	347	1452	Conductor
112	DC	WI	1	795 ACSR Drake	311	1301	311	1301	Conductor
150	TU	DC	1	795 ACSR Drake	311	1301	311	1301	Conductor
113	EL	RO	1	795 ACSR Drake	163	684	163	684	Conductor
				1365 ACAR					
114	NL	RI	1	795 ACSR Drake	382	1600	382	1600	Breaker
115	EL	NE	1	795 ACSR Drake	382	1600	382	1600	Breaker
117	TO	NL	2	954 ACSS 45/7 Rail	359	1501	359	1501	Conductor
118	TO	NL	1	954 ACSS 45/7 Rail	347	1452	347	1452	Conductor
120	RI	LC	1	795 ACSR Drake	379	1586	379	1586	Conductor
121	ST	RO	1	795 ACSR Drake	250	1046	250	1046	Conductor
122	NL	RV	1	954 ACSR Rail	376	1574	376	1574	Conductor
125	TO	NL	3	1365 ACAR	406	1699	406	1699	Conductor
123	SN	NE	1	477 ACSR, Hawk	389	1626	389	1626	Conductor
				954 ACSS 45/7 Rail					
124	RI	NE	1	795 ACSR Drake	370	1547	370	1547	Breaker
126	EL	SN	1	954 ACSR Rail	227	950	227	950	Conductor
127	DP	NE	1	1365 ACAR	287	1200	287	1200	Breaker
128	RV	LC	1	954 ACSR Rail	343	1434	343	1434	Conductor
129	DR	MV	1	954 ACSR Rail	456	1908	456	1908	Conductor
130	IR	DR	1	795 ACSR Drake	348	1456	348	1456	Conductor
131	IR	SC	1	795 ACSR Drake	348	1456	348	1456	Conductor
132	NL	WI	1	795 ACSR Drake	382	1600	382	1600	Breaker
136	RB	VL	1	795 ACSR Drake	418	1749	418	1749	Conductor
139	DP	SC	1	795 ACSR Drake	418	1749	418	1749	Conductor
140	22	IR	1	954 ACSR Rail	343	1434	343	1434	Conductor
141	SO	GV	1	954 ACSR Rail	227	950	227	950	Conductor
145	22	EL	1	954 ACSS-HS "RAIL"	478	2000	478	2000	Breaker
146	PO	LR	1	795 ACSR Drake	400	1673	400	1673	Conductor
147	EL	PO	1	795 ACSR Drake	369	1544	369	1544	Conductor
160	CI	ST	1	795 ACSR Drake	418	1749	418	1749	Conductor

TEP EHV Transmission Line Ratings - 2010
(Series Caps Bypassed)

LINE NOTATION						CIRCUIT RATING				Limiting Element
S1 ID	series cap		S2 ID	Ckt	LENGTH (MI)	CONTINUOUS		EMERGENCY		All Series Caps Bypassed
	ID	bypassed? (1)				MVA	AMP	MVA	AMP	
SJ			MK	1	90	925	1548	1076	1800	CT Thermal Limit & Relay Thermal Limit
	SC	YES								
SJ			MK	2	90	845	1414	956	1600	CT Thermal Limit & Relay Thermal Limit
	SC	YES								
MC			SP	1	107	925	1548	1110	1858	CT Thermal Limit
MC			SP	2	107	925	1548	1110	1858	CT Thermal Limit
SP			CO	1	22	755	1264	765	1280	CT Thermal Limit & Relay Thermal Limit
SP			GL	1	110	925	1548	1110	1858	CT Thermal Limit
	SC	YES								
SP			VL	1	110	717	1200	717	1200	Relay Thermal Limit
	SC1	YES								
	SC2	YES								
					0					
GL			WN	1	88	925	1548	1110	1858	CT Thermal Limit
WN			VL	1	41	925	1548	1110	1858	CT Thermal Limit
	SC	YES								
VL			SO	1	14	925	1548	956	1600	CT Thermal Limit & Relay Thermal Limit
WW			PW	1	60	925	1548	1076	1800	CT Thermal Limit & Relay Thermal Limit
PW			SO	1	118	925	1548	1110	1858	CT Thermal Limit
SA			TO	1	1	1039	1200	1247	1440	CT Thermal Limit
SA			TO	2	1	1039	1200	1247	1440	CT Thermal Limit