

Cerbat Water Compa



0000135442

ORIGINAL

7313 E. Concho Dr., Suite B Kingman, AZ
(928)757-2205 phone (928)757-2217 fax

Arizona Corporation Commission
Compliance Department
1200 W. Washington St.
Phoenix, AZ 85007

March 22nd, 2012

Docket # W-02391A-10-0218 Decision # 72739
Docket # W-02391A-11-0166
Docket # W-02391A-11-0309
Re: Interconnection Meter

As ordered as a compliance item in this docket, Cerbat Water Company is demonstrating that we have a meter at the interconnection location in our water system. Pictures are included showing the interconnection and the meter. Because we only have one well and therefore, only one interconnection, we can track the water entering our system using this meter.

When the new well is drilled and put into service, it will also be metered and tracked for the purpose of reporting the water pumped and sold within our water system.

We are aware of the requirement to report 12 consecutive months of this data by April of 2013. We are beginning to track this information separately in order to provide the Commission with this data next year.

Please contact me any time if you have any questions.

Respectfully,

Michelle Monzillo
Manager

Arizona Corporation Commission

DOCKETED


MAR 28 2012


DOCKETED BY

RECEIVED
2012 MAR 28 A 11:19
AZ CORP COMMISSION
DOCKET CONTROL

Meter

Well

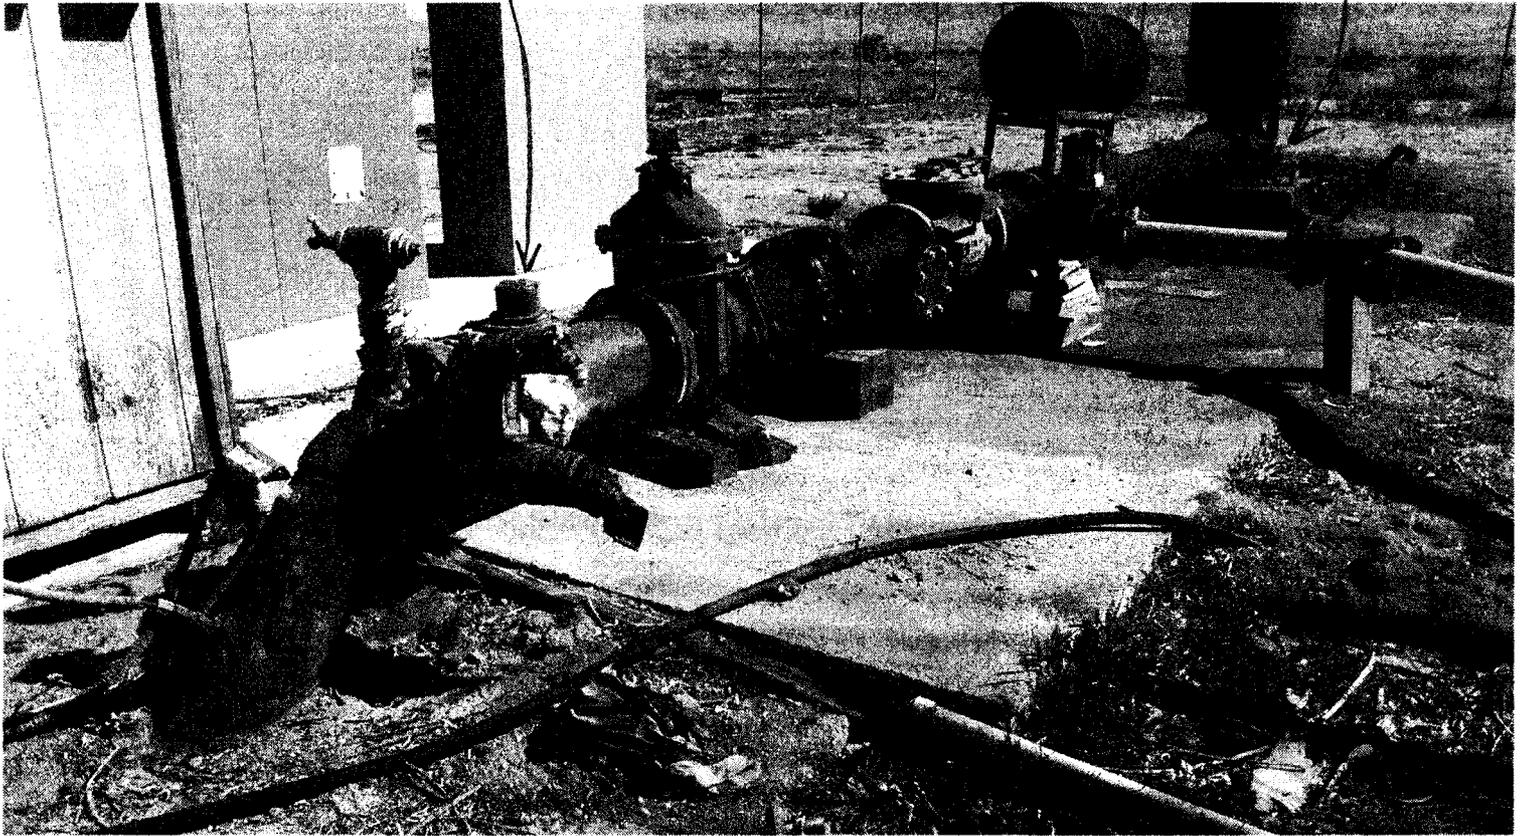

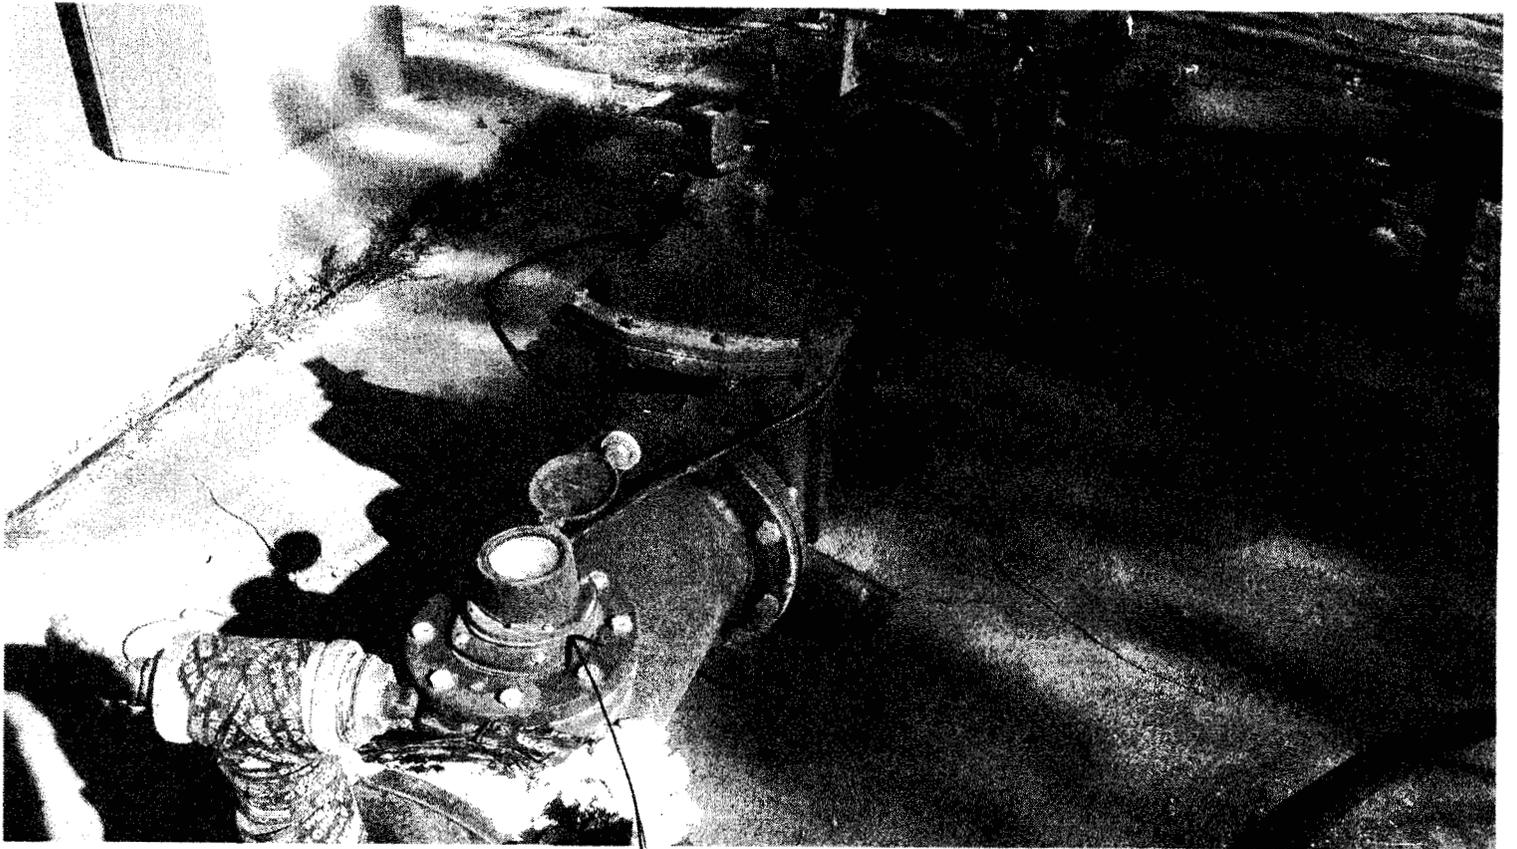

Meter