

ORIGINAL

GILA BEND POWER PARTNER

5949 Sherry Lane, Suite 1900

Dallas, Texas 75225-6553

Telephone: (214) 210-5000

Facsimile: (214) 210-5087



0000143196

RECEIVED
AZ CORP COMMISSION
DOCKET CONTROL

February 27, 2013

2013 MAR 4 PM 1 03

VIA OVERNIGHT DELIVERY

Arizona Corporation Commission
Utilities Division
1200 West Washington Street
Phoenix, Arizona 85007
Attention: Ernest Johnson, Director

Arizona Corporation Commission

DOCKETED

MAR 4 2013

DOCKETED BY

Re: Self-Certification Letter

Arizona Corporation Commission – Decision #63762, as amended by Decision #69177, and 72188; Docket Control #L-00000V-01-0109 and Docket Control #L-00000V-00-0106

Dear Mr. Johnson:

Gila Bend Power Partners, LLC (“GBPP” or “Applicant”) submits this self-certification letter pursuant to the above Decision Number for the Certificate of Environmental Compatibility (“CEC”) for GBPP’s project in Gila Bend, Arizona.

On or about December 5, 2006, the Arizona Corporation Commission issued Decision Number 69177 extending the expiration date of this CEC until February 7, 2011 (the “First Extension Order”), and the CEC was subsequently extended to February 7, 2018 pursuant to ACC Decision Number 72188 docketed February 15, 2011 (the “Second Extension Order”). The First Extension Order added nine additional conditions to the existing CEC. The Second Extension Order did not add any additional environmental conditions or any suitable to annual certification. As it has in years past, GBPP is filing this self-certification letter addressing the original CEC conditions and will file an additional August letter addressing GBPP’s compliance efforts as of June 30th with the CEC conditions contained in the First Extension Order.

The activities relating to the conditions established by the First Extension Order are as follows and the reference numbers correspond to the conditions as numbered in the First Extension Order:

- 6. GBPP is filing this self-certification letter prior to August 1st, describing conditions that have been met as of June 30. This letter and the documents enclosed herewith explain or demonstrate compliance efforts for those conditions fulfilled or in the process of being fulfilled.

7. GBPP reports the status of its continuing actions to comply with Condition Numbers 1, 2 and 3(H) of Decision # 63762:

Condition 1: The construction of the power generation station has been delayed due to market conditions and has not yet started; however, construction and operation of the station will comply with applicable air and water pollution control standards and regulations, and with all applicable ordinances, master plans, and regulations of the State of Arizona, the County of Maricopa, the United States, and any other governmental entity having jurisdiction.

Condition 2: GBPP has not, to date, executed a transmission agreement with APS or SRP, as the construction of the power generation station has not yet commenced. However, a copy of any transmission agreements will be forwarded to the Arizona Corporation Commission as soon as the documents are completed and signed, but in no event later than 30 days after execution.


Condition 3(H): GBPP is identifying firms and entities that would be most suitable for conducting the required native plant survey prior to construction. Such survey will be completed in advance of the commencement of construction with sufficient time allotted to develop and implement a plant-salvage program if deemed necessary.

8. GBPP has annually filed all required ten-year plans with the Commission in accordance with A.R.S. §40-360-2.A., a copy of the most recent of which is enclosed. Historical copies of ten year plans are available on request. GBPP intends to monitor and participate in discussions regarding the Gila Bend Transmission Initiative.
9. GBPP has not initiated or pursued a legal challenge to any of the conditions contained in the First Extension Order.

Should you need any additional information, please do not hesitate to contact the undersigned.

Regards,

GILA BEND POWER PARTNERS, LLC
By: Sammons Power Development, Inc.,
Its Managing Member

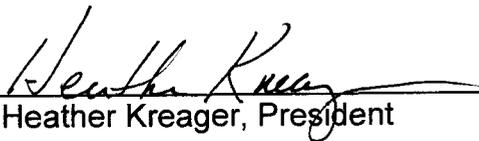By: 
Heather Kreager, President

Enclosures

cc: Arizona Attorney General (w/encls.)
Department of Commerce Energy Office (w/encls.)
Arizona Department of Water Resources (w/encls.)

GILA BEND POWER PARTNERS, LLC

5949 Sherry Lane, Suite1900

Dallas, Texas 75225-6553

Telephone: (214) 210-5000

Facsimile: (214) 210-5087

January 21, 2013

VIA OVERNIGHT DELIVERY

Arizona Corporation Commission
Utilities Division
1200 West Washington Street
Phoenix, Arizona 85007

Re: 10-YEAR TRANSMISSION PLAN-2013

Gentlemen:

Enclosed please find 13 copies of the 10-Year Transmission Plan–2013 for Gila Bend Power Partners, LLC. The project is on hold due to current market conditions, so the plan has not been revised since Gila Bend's prior submission.

If you need anything further, please let me know.

Yours truly,

HEATHER KREAGER

HK:lk

GILA BEND POWER PROJECT

2013 10-YEAR TRANSMISSION PLAN

Prepared for the:

**ARIZONA CORPORATION COMMISSION
UTILITY DIVISION**

BY: GILA BEND POWER PARTNERS, LLC

**Report on the Gila Bend Power Partners, LLC.'s
Generation Project System Impact Study**

**Prepared For the
Industrial Power Technology
And
Palo Verde E & O Committee**

**By
James C. Hsu
Salt River Project**

November 1, 2001

Version (C)

Gila Bend Power Partners Generation Project System Impact Study Report

I. Introduction

Industrial Power Technology (IPT), on behalf of the Gila Bend Power Partners, LLC (GBPP) has requested Salt River Project (SRP) to perform a system impact study that will assist GBPP in the determination of the Palo Verde transmission system and the WSCC interconnected system impact of interconnecting the proposed GBPP Generation Project with the another proposed Panda Gila River Generation Project's planned Gila River-Jojoba 500 kV double circuit lines. These double circuit 500 kV lines will be tied to the existing Hassayampa-Kyrene 500 kV line. Currently, GBPP has proposed to build a combined cycle power plant of 833 MW in addition to the 2080 MW of new generation power plant proposed by the Gila River Panda Project (Panda) in the same vicinity. In response to this request, SRP has carried out the study work accordingly, and documented the study results in this brief report.

For this analysis, the proposed size of the GBPP project was assumed to be 833 MW. Coincident with the development of the GBPP project, a separate generation proposal called the Gila River Panda Project (2080 MW) is also being developed and it will be interconnected to the Palo Verde transmission system via a double circuit 500kV line from the Gila River generation site to Jojoba, a new switchyard that is being developed to interconnect the two 500kV lines with the existing Palo Verde – Kyrene 500kV line. The GBPP project will interconnect with the system via a new, single circuit 500kV line to Watermelon substation, a new switchyard the GBPP plans to build, located approximately 2 miles from the Gila River Power facility. The Gila River – Jojoba 500kV lines will be looped into the Watermelon switchyard. SRP's system analysis assessed the system impact of both the Gila River Panda and GBPP generation projects on the interconnected WSCC system.

SRP's analysis focused on the capability of the Palo Verde area transmission system to deliver a total of 2913 MW of new generation from both proposed projects (GBPP and Gila River Panda) into the interconnected system. The scope of the study was to identify any significant system impacts that may be caused by interconnecting the GBPP generation project with the Jojoba-Gila River double circuit 500 kV lines, the Hassayampa-Kyrene 500 kV line, and their associated switchyards. This study did not identify any mitigation measures that may be required as a result of system impacts attributable to the GBPP Generation Project. Therefore, neither a preliminary plan of service nor a cost estimate for interconnecting the Proposed Generation Project with the existing and planned 500 kV transmission system was provided.

The purpose of this System Study was to assess the impact of the GBPP project on the Palo Verde transmission and the integrated WSCC EHV transmission system. The study is comprised of limited power flow and stability studies, but does not include any short circuit, post-transient power flow or subsynchronous resonance studies. Any conclusions presented from this System Impact Study represent the opinion of SRP and not necessarily the opinion of the Palo Verde Transmission System Engineering and Operating Committee.

The following two transmission configurations were assessed in this analysis:

Configuration 1:

The GBPP Project will be interconnected to the planned Jojoba-Gila River 500 double circuit lines at a location approximately 2 miles from the Gila River 500 kV switchyard (Watermelon substation). This transmission configuration assumed that the Gila River Generating Project would install a 500/230 kV transformer at their Gila River substation to accommodate an interconnection of the existing Liberty-Gila Bend 230 kV line.

Configuration 2:

Configuration 2 represents the same 500 kV transmission configuration as Configuration 1, however, the 500/230 kV transformer at the Gila River 500kV substation was not modeled.

II. Review of Panda System Development and Pertinent Study Results

Included in the "Report on the Preliminary Study For the Palo Verde Interconnection" and "Report on the Panda Generation Project Sensitivity Study", some technical study results pertinent to the Panda Generation Project and the impact assessment of its system development were documented in a number of different sections throughout these reports. It should be pointed out that these study results varied depending upon the system conditions, system models and the Panda's transmission network used in those studies. The following table summarizes the study results, associated information, and specific references from these reports.

New Generation Accommodated	Panda Interconnection To Palo Verde	Panda 500/230 KV Transformer	Transmission Constraint	Reference
4,850 MW (Including Panda 1250 MW & PDE 550 MW GEN)	Panda Project Looping in & out of PV-KY line	No	Thermal and Stability	PV Interconnection Study Report Section III.B2 (Pg.27) Exhibit 2
5,240 MW (Including Panda 1640 MW & PDE 550 MW GEN)	Building Jojoba-Panda 500 KV double circuit lines and Jojoba cutting into PV-Kyrene line	Yes (with 390 MW flow)	Thermal and Stability	Panda Project Sensitivity Study Report Section III.1&2 (Pg.4) Tables PF-7 & TS-15

These previous study results revealed the following observations:

1. For the 2003 heavy summer condition with the addition of Palo Verde-Estrella line, "New Generation" in the amount of 4,850 MW can be accommodated by the Palo Verde transmission system without installation of a Panda 500/230 kV transformer.
2. Approximately 390 MW increase in the Panda Gila River Generation Plant output can be dispatched if the Panda project is interconnected with the Arizona local 230 kV transmission system by installing a 500/230 kV transformer.
3. The Palo Verde transmission thermal limits were constrained by the respective continuous rating of either the Hassayampa-N. Gila 500 kV line or the Hassayampa-Kyrene 500 kV line.
4. The Palo Verde stability limit was determined by a three-phase fault on the Palo Verde 500 kV bus and a subsequent loss of both Palo Verde-Westwing 500 kV lines.

As mentioned in the summary table above, the Panda sensitivity studies were performed based on the following assumptions:

1. The Panda Gila River Generation Project (Panda Gen) was the only project to interconnect with the Hassayampa-Kyrene 500 kV line.
2. The GBPP Generation Project was interconnected to the Hassayampa 500 kV Switchyard via a single circuit 500 kV line.
3. The generation output for the Panda Gen and GBPP projects were not maximized. The Panda Gen Project was dispatched in the ranges of 1250 MW to 1640 MW and PDE Gen Project was dispatched at 550 MW.

The current plan, as proposed by GBPP, is to interconnect with the Jojoba-Gila River 500 kV double circuit lines at an intersection about 2 miles north of the Gila River 500 kV Switchyard (Watermelon). Given these modifications in system representation, it was necessary to perform additional study work to assess the impact of these system modifications on the Palo Verde and the interconnected WSCC system with an emphasis on dispatching the maximum generation for both Panda Gen Project (2080 MW) and GBPP Generation Project (833 MW).

III. Conclusions

Based on the results of this impact study, the following was concluded:

1. The maximum generation that can be scheduled out of the Gila River vicinity to the Arizona and California load centers is a function of the capability of some of the Palo Verde transmission system components. This transmission capability is based on a thermal limitations on either the Hassayampa- N. Gila line 500 kV line or the Hassayampa-Kyrene 500 kV line.

- a) The maximum GBPP generation that can be accommodated by the Configuration 1 transmission system (without Panda 500/230 kV transformer) is about 583 MW if the Panda Gila River generation is maximized at 2080 MW output.
 - b) The maximum new GBPP generation can be increased to 683 MW for the Configuration 2 transmission system (with Panda 500/230 kV transformer) if the Panda generation was still at its maximum output of 2080 MW.
2. The interconnection of the proposed GBPP Generation Project with the respective amount of power schedule noted in 1.a and 1.b above will not have any adverse impact on the Palo Verde Nuclear Plant, its associated transmission system, and the WSCC interconnected system.
 3. The common corridor outage for a simultaneous loss of both Jojoba-Gila River double circuit 500 kV lines and a subsequent trip of combined maximum generation output (a total of 2911 MW) will not cause a stability problem. The interconnected transmission system can withstand such critical outage without causing wide spread cascading outages. The consequence of this double circuit outage is comparable to the result of a simultaneous trip of two Palo Verde generators. Both double contingencies are acceptable and meet the WSCC Performance Criteria Level C.
 4. The stability performance resulting from a three-phase fault on the Palo Verde 500 kV bus and fault cleared by loss of both two Palo Verde-Westwing 500 kV lines became less severe due to power flow displacement for these two critical lines when more Panda and GBPP generation was dispatched at the Gila River location, which is further away from the Palo Verde vicinity.

IV. Discussion on Study Results

(A) Power Flow Impact

The following technical discussion is based on the various system conditions studied and demonstrate no adverse power flow impact on the Palo Verde and the Southwest interconnected transmission system due to the Gila River interconnection of the GBPP Generation Project.

1. Configuration 1 (Without Panda 500/230 kV Connection):

(See PF-TABLE 1)

Benchmark System (Without GBPP Project):

For base case conditions, that included accommodation of new generation of 4,650 MW by the Palo Verde transmission system, the heaviest loadings on both the Hassayampa-N. Gila and Jojoba-Kyrene 500 kV lines were occurred. They were reached at 100.5% and 100.4% of their continuous ratings, respectively. Neither N-1 contingency problems nor low system voltages were noted.

Post-GBPP System (With GBPP Project):

For base case conditions with 4,650 MW of new generation that included the power schedule of 833 MW of GBPP generation and 2080 MW of Panda Gila River generation to deliver to the Palo Verde transmission system, the heaviest loadings on both the Hassayampa-N. Gila and Jojoba-Kyrene 500 kV lines occurred. Flow on these lines reached 100.6% and 106.4% of their continuous ratings, respectively. A slight overload also occurred on the remaining Jojoba-Gila River Tap 500 kV line (101.1% of its emergency rating) for loss of one Jojoba-Gila River Tap 500 kV line.

Further studies indicated that these overloading problems could be overcome if the GBPP generation output was reduced to 583 MW. As a result, the loading on the Jojoba-Kyrene 500 kV line was reduced to 100.3% of its continuous rating. The remaining Gila River Tap-Jojoba 500 kV line loading was reduced to 91.5% of its emergency rating for a loss of one Gila River Tap-Jojoba 500 kV line.

1. Configuration 2 (With Panda 500/230 kV Connection):

(See PF-TABLE 2)

Benchmark System (Without GBPP Project):

For base case conditions, that included accommodation of new generation of 5,040 MW by the Palo Verde 500 kV and local 230 kV transmission systems, the heaviest loadings on both the Hassayampa-N. Gila and Jojoba-Kyrene 500 kV lines occurred. Flows on these lines reached 100.1% and 100.0% of their continuous ratings, respectively. No N-1 contingency problems or low system voltages were noted.

Post-GBPP System (With GBPP Project):

For base case conditions with 5,070 MW of new generation that included the power schedule of 833 MW of GBPP generation and 2080 MW of Panda Gila River generation to deliver to the Palo Verde 500 kV and local 230 kV transmission systems, the heaviest loadings on both the Hassayampa-N. Gila and Jojoba-Kyrene 500 kV lines occurred. They reached 100.2% and 104.6% of their continuous ratings, respectively. No overload occurred on the remaining Jojoba-Gila River Tap 500 kV line (84.1% of its emergency rating) for loss of one Jojoba-Gila River Tap 500 kV line. No voltage problems were detected for any N-1 contingencies.

Further studies indicated that this overloading problem could be overcome if the GBPP generation output was reduced to 683 MW. As a result, the loading on the Jojoba-Kyrene 500 kV line was reduced to 100.3% of its continuous rating. The remaining Gila River Tap-Jojoba 500 kV line loading was reduced to 79.0% of its emergency rating for a loss of one Gila River Tap-Jojoba 500 kV line.

(B) Transient Stability Impact

The stability analysis based on the following various system conditions indicated that no adverse impact on the Palo Verde plant stability and the integrated WSCC transmission system due to the interconnection of the GBPP Generation Project to the Palo Verde transmission system.

1. Configuration 1 (Without Panda 500/230 kV Connection):

(See TS-TABLE 1)

Benchmark System (Without GBPP Gen Project):

The following three N-2 contingency outages were established for stability benchmark performance using the pre-GBPP Project power flow limit case:

- (a) Three-phase fault at the Jojoba 500 kV bus with outage of two Jojoba-Gila River 500 kV lines and a subsequent trip Panda generation of 2080 MW
- (b) A simultaneous trip of two Palo Verde generators (loss of 2909 MW generation)
- (c) Three-phase fault at the Palo Verde 500 kV bus with outage of two Palo Verde-Westwing 500 kV lines

For the Pre-GBPP Project benchmark system, the stability results showed that all three N-2 contingency outages were stable and damped. The worst case was a simultaneous loss of two Palo Verde generators (loss of 2809 MW generation). This case resulted in a maximum transient voltage dip of 0.86 P.U. (22% deviation) at the Malin 500 kV bus. The next worst case was a three-phase fault at the Palo Verde 500 kV bus and fault cleared by the loss of two Palo Verde-Westwing 500 kV circuits. This case resulted in maximum voltage dips of 0.91 P.U. (15% deviation) and 0.92 P.U. (16% deviation) respectively, at the Palo Verde and Malin 500 kV buses. The least critical case was a three-phase fault at the Jojoba 500 kV bus with outage of two Jojoba-Gila River 500 kV circuits and a subsequent trip of 2080 MW of Panda generation. This case caused a maximum transient voltage dip of 0.95 P.U. (13% deviation) at the Malin 500 kV bus.

Post-GBPP(833 MW) Project System (With GBPP Project):

All three contingency outages simulated for the Pre-Project system were also tested in the Post-Project system. All stability results were stable and damped. The worst case was a three-phase fault at the Jojoba 500 kV bus with outage of two Jojoba-Gila River 500 kV circuits and a subsequent trip of about 2900 MW of combined Panda and GBPP generation. This case resulted in a maximum transient voltage dip of 0.81 P.U. (27% deviation) at the Malin 500 kV bus. The next worst case was a simultaneous loss of two Palo Verde generators (loss of 2809 MW generation). This case resulted in a maximum transient voltage dip of 0.86 P.U. (22% deviation) at the Malin 500 kV bus. The least critical case was a three-phase fault at the Palo Verde 500 kV bus with fault cleared by the loss of two Palo Verde-Westwing 500 kV circuits. This case resulted in maximum voltage dips of 0.95 P.U. (11% deviation) and 0.98 P.U. (10% deviation) respectively, at the Palo Verde and Malin 500 kV buses.

2. Configuration 2 (With Panda 500/230 kV Connection):

(See TS-TABLE 2)

Benchmark System (Without GBPP Project):

The following three N-2 contingency outages were established for stability benchmark performance using the pre-GBPP Project power flow limit case:

- (a) Three-phase fault at the Jojoba 500 kV bus with outage of two Jojoba-Gila River 500 kV lines and a subsequent trip Panda generation of 1560 MW
- (b) A simultaneous trip of two Palo Verde generators (loss of 2809 MW generation)
- (c) Three-phase fault at the Palo Verde 500 kV bus with outage of two Palo Verde-Westwing 500 kV lines

For the Pre-GBPP Project benchmark system, the stability results showed that all three N-2 contingency outages were stable and damped. The worst case was a simultaneous loss of two Palo Verde generators (loss of 2809 MW generation). This case resulted in a maximum transient voltage dip of 0.86 P.U. (22% deviation) at the Malin 500 kV bus. The next worst case was a three-phase fault at the Palo Verde 500 kV bus and fault cleared by the loss of two Palo Verde-Westwing 500 kV circuits. This case resulted in maximum voltage dips of 0.95 P.U. (11% deviation) and 0.98 P.U. (10% deviation) respectively, at the Palo Verde and Malin 500 kV buses. The least critical case was a three-phase fault at the Jojoba 500 kV bus with outage of two Jojoba-Gila River 500 kV circuits and a subsequent trip of 1560 MW of Panda generation. This case caused a maximum transient voltage dip of 0.98 P.U. (13% deviation) at the Malin 500 kV bus.

Post-GBPP(833 MW) Project System (With GBPP Project):

All three contingency outages simulated for the Pre-Project system were also tested in the Post-Project system. All stability results were stable and damped. The worst case was a simultaneous loss of two Palo Verde generators (loss of 2809 MW). This case resulted in a maximum transient voltage dip of 0.86 P.U. (22% deviation) at the Malin 500 kV bus. The next worst case was a three-phase fault at the Jojoba 500 kV bus with outage of two Jojoba-Gila River 500 kV circuits and a subsequent trip of about 2393 MW of combined Panda and GBPP generations. This case caused a maximum transient voltage dip of 0.90 P.U. (18% deviation) at the Malin 500 kV bus. The least critical case was a three-phase fault at the Palo Verde 500 kV bus with fault cleared by the loss of two Palo Verde-Westwing 500 kV circuits. This case resulted in maximum voltage dips of 0.95 P.U. (11% deviation) and 0.98 P.U. (10% deviation) respectively, at the Palo Verde and Malin 500 kV buses.

V. Exhibit

Exhibit 1 shows a one-line system diagram of transmission alternatives associated with the GBPP interconnection.


VI. Summary Tables of Study Results

(The attached tables summarize the study results)

1. PF-Table 1: Power Flow Impact With And Without GBPP (833 MW) Project
(Without the Panda Gila River 500/230 KV Transformer)
2. TS-Table1: Stability Impact With And Without GBPP (833 MW) Project
(Without the Panda Gila River 500/230 KV Transformer)
3. PF-Table 2: Power Flow Impact With And Without GBPP (833 MW) Project
(With the Panda Gila River 500/230 KV Transformer)
2. TS-Table 2: Stability Impact With And Without GBPP (833 MW) Project
(With the Panda Gila River 500/230 KV Transformer)

GILA BEND POWER PARTNERS (GBPP) GENERATION PROJECT TRANSMISSION ALTERNATIVE 1

Configuration 1: GBPP Project w/o Panda 500/230kV Transformer

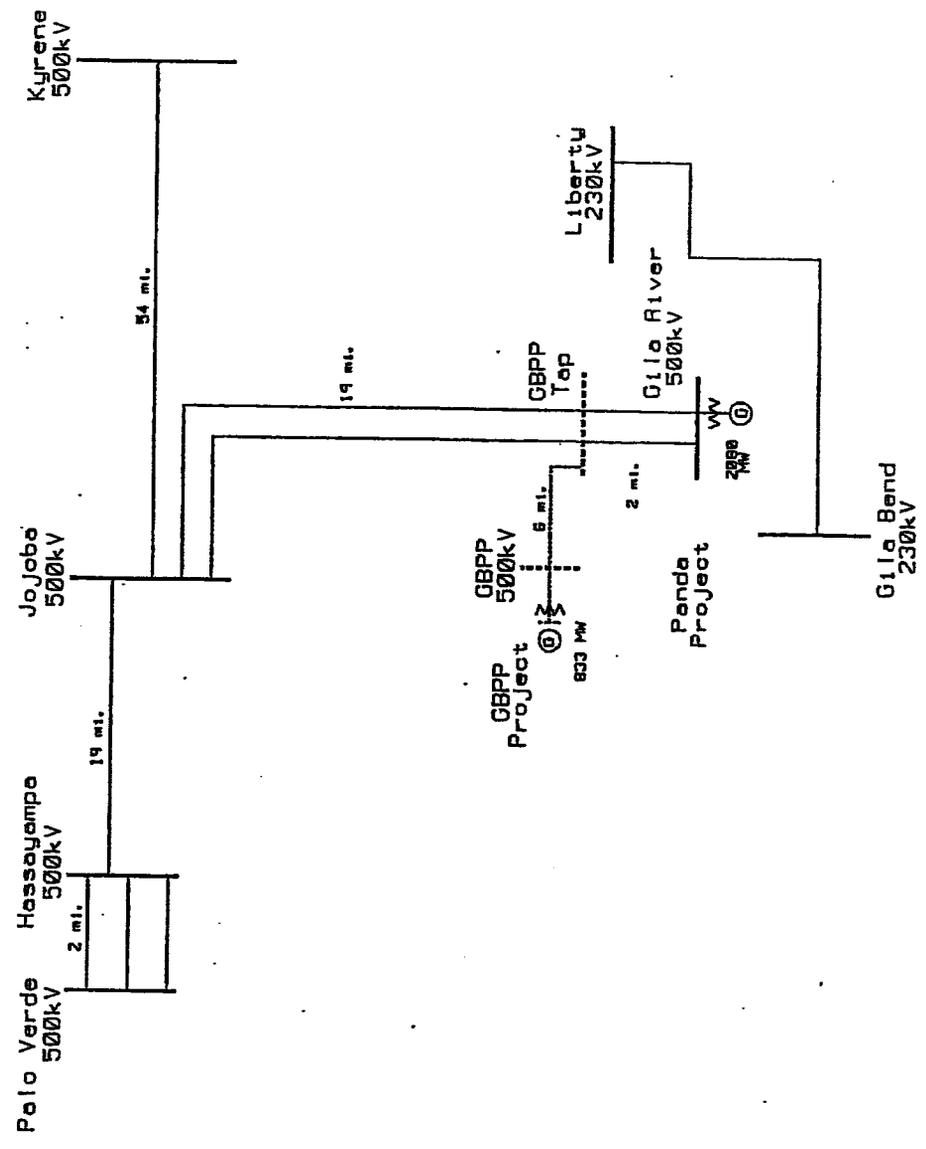

PF-TABLE 1

POWER FLOW IMPACT WITH AND WITHOUT THE GBPP(833MW) GEN PROJECT
(WITHOUT THE PANDA GILA RIVER 500/230 KV TRANSFORMER)

BENCH MARK	CASE DESCRIPTION	FOR GBPP AND PANDA GEN		FOR GBPP AND PANDA GEN		FOR GBPP AND PANDA GEN		FOR GBPP AND PANDA GEN		FOR GBPP AND PANDA GEN		PPK 230KV (PU)	KYR 230KV (PU)	COMMENTS
		REG	GEN	REG	GEN	REG	GEN	REG	GEN	REG	GEN			
2003HS-PDE-01	BASE CASE FLOW	1283	1341	1528	1528	1784	1009	1182	1.03	1.01	6% MAX	5% MAX	NO PROBLEM	
ALT A	FACILITY RATING	1400	1807	3000	3000	2000	2100	2000	1.03	1.01	NO PROBLEM	NO PROBLEM	NO PROBLEM	
	CONTINUOUS RATING	1880	1477	3200	3200	2521	3150	2521	1.03	1.01	NO PROBLEM	NO PROBLEM	NO PROBLEM	
	EMERGENCY RATING	1400	1477	1676	1676	1114	1114	1346	1.03	1.01	NO PROBLEM	NO PROBLEM	NO PROBLEM	
	% OF CONTINUOUS RATING	77.70%	77.70%	55.70%	55.70%	55.10%	55.10%	87.30%	1.03	1.01	NO PROBLEM	NO PROBLEM	NO PROBLEM	
ALT B	ONE PALO VERDE-WWG OUT	1483	1607	3000	3000	2282	1118	1588	1.02	1.00	NO PROBLEM	NO PROBLEM	NO PROBLEM	
	% OF EMERGENCY RATING	78.50%	66.10%	84.60%	84.60%	88.70%	35.50%	82.90%	1.02	1.00	NO PROBLEM	NO PROBLEM	NO PROBLEM	
ALT C	PALO VERDE-ESTRELLA OUT	1458	1557	2113	2113	2397	1122	1892	1.01	0.99	NO PROBLEM	NO PROBLEM	NO PROBLEM	
	% OF EMERGENCY RATING	77.20%	64.10%	66.00%	66.00%	95.10%	35.60%	75.10%	1.01	0.99	NO PROBLEM	NO PROBLEM	NO PROBLEM	
ALT D	JOJOBA-KYRENE OUT	1486	1617	2330	2330	OUT	1102	1892	1.00	0.98	NO PROBLEM	NO PROBLEM	NO PROBLEM	
	% OF EMERGENCY RATING	79.20%	68.60%	72.80%	72.80%	OUT	35.00%	75.10%	1.00	0.98	NO PROBLEM	NO PROBLEM	NO PROBLEM	
2003HS-PDE-02	ONE JOJOB- GILA RIVER OUT	1407	1477	1676	1676	2008	2239	1348	1.03	1.01	NO PROBLEM	NO PROBLEM	NO PROBLEM	
	% OF EMERGENCY RATING	74.40%	60.80%	62.40%	62.40%	78.70%	71.10%	53.50%	1.03	1.01	NO PROBLEM	NO PROBLEM	NO PROBLEM	
ALT A	BASE CASE FLOW	1288	1343	1489	1489	1884	1431	1154	1.03	1.01	NO PROBLEM	NO PROBLEM	NO PROBLEM	
	FACILITY RATING	1400	1479	1632	1632	1588	1588	1314	1.03	1.01	NO PROBLEM	NO PROBLEM	NO PROBLEM	
	CONTINUOUS RATING	1880	1479	3200	3200	2521	3150	2521	1.03	1.01	NO PROBLEM	NO PROBLEM	NO PROBLEM	
	EMERGENCY RATING	1400	1479	1634	1634	1114	1114	1346	1.03	1.01	NO PROBLEM	NO PROBLEM	NO PROBLEM	
ALT B	ONE PALO VERDE-WWG OUT	1463	1605	3000	3000	2376	1582	1849	1.02	1.00	NO PROBLEM	NO PROBLEM	NO PROBLEM	
	% OF EMERGENCY RATING	78.50%	68.10%	82.40%	82.40%	84.30%	50.50%	61.40%	1.02	1.00	NO PROBLEM	NO PROBLEM	NO PROBLEM	
ALT C	PALO VERDE-ESTRELLA OUT	1459	1557	2060	2060	2509	1595	1892	1.01	0.99	NO PROBLEM	NO PROBLEM	NO PROBLEM	
	% OF EMERGENCY RATING	77.20%	64.10%	64.40%	64.40%	99.50%	50.60%	75.10%	1.01	0.99	NO PROBLEM	NO PROBLEM	NO PROBLEM	
ALT D	JOJOBA-KYRENE OUT	1508	1631	2328	2328	OUT	1577	1892	1.00	0.97	NO PROBLEM	NO PROBLEM	NO PROBLEM	
	% OF EMERGENCY RATING	78.70%	66.60%	72.80%	72.80%	OUT	50.10%	75.10%	1.00	0.97	NO PROBLEM	NO PROBLEM	NO PROBLEM	
PDE-02R	ONE JOJOB- GILA RIVER OUT	1409	1479	1634	1634	2129	1316	1316	1.03	1.00	NO PROBLEM	NO PROBLEM	NO PROBLEM	
	% OF EMERGENCY RATING	74.60%	60.90%	51.10%	51.10%	84.50%	62.20%	62.20%	1.03	1.00	NO PROBLEM	NO PROBLEM	NO PROBLEM	
ALT D	BASE CASE (IN MW)	1257	1330	1440	1440	1792	1308	1128	1.03	1.01	NO PROBLEM	NO PROBLEM	NO PROBLEM	
	EMERGENCY RATING	1466	1466	1578	1578	1434	1285	1285	1.03	1.01	NO PROBLEM	NO PROBLEM	NO PROBLEM	
ALT D	ONE JOJOB- GILA RIVER OUT	1400	1465	1880	1880	2007	2894	1286	1.03	1.00	NO PROBLEM	NO PROBLEM	NO PROBLEM	
	% OF EMERGENCY RATING	74.10%	60.30%	48.40%	48.40%	79.80%	81.50%	51.02%	1.03	1.00	NO PROBLEM	NO PROBLEM	NO PROBLEM	

PF-TABLE 2

POWER FLOW IMPACT WITH AND WITHOUT THE GBPP(833MW) GEN PROJECT
(WITH THE PANDA GILA RIVER 500/230 KV TRANSFORMER)

BENCH MARK	CASE DESCRIPTION	FOR GBPP PANDA GILA RIVER AND PALO VERDE GEN PROJECT		FOR GBPP PANDA GILA RIVER AND PALO VERDE GEN PROJECT		FOR GBPP PANDA GILA RIVER AND PALO VERDE GEN PROJECT		FOR GBPP PANDA GILA RIVER AND PALO VERDE GEN PROJECT		PPK 230KV (PU)	KYR 230KV (PU)	COMMENTS
		W/OUT GEN	W/OUT GEN									
2003HS PDE-03	BASE CASE (IN MW)	1269	1336	1518	1518	1772	1772	808	808	1.02	1.00	
	FACILITY RATING	(AMP)	(AMP)	(AMP)	(AMP)	(AMP)	(AMP)	(AMP)	(AMP)	5% MAX	5% MAX	
	CONTINUOUS RATING	1400	1900	3000	3000	2000	2000	2100	2100	1.02	1.00	
	EMERGENCY RATING	1880	2430	3200	3200	2521	2521	3150	3150			
	BASE CASE FLOW(AMP)	1471	1471	1676	1676	894	894	884	884			
	% OF CONTINUOUS RATING	77.40%	77.40%	55.70%	55.70%	42.80%	42.80%	68.20%	68.20%			
ALT A	OUTAGE CASE FLOW(AMP)	1487	1583	OUT	OUT	2238	2238	872	872	1.02	1.00	
	ONE PALO VERDE-WWG OUT	77.50%	85.10%	OUT	OUT	88.80%	88.80%	27.70%	27.70%			
	% OF EMERGENCY RATING											
ALT B	PALO VERDE-ESTRELLA OUT	1444	1538	2105	2105	2377	2377	866	866	1.01	0.89	
	% OF EMERGENCY RATING	78.40%	83.20%	65.80%	65.80%	94.30%	94.30%	27.50%	27.50%			
ALT C	JOJOBA-KYRENE OUT	1474	1586	2274	2274	OUT	OUT	793	793	1.00	0.87	
	% OF EMERGENCY RATING	78.00%	85.30%	71.10%	71.10%	OUT	OUT	25.20%	25.20%			
ALT D	ONE JOJOB- GILA RIVER OUT	1400	1488	1888	1888	1889	1889	1761	1761	1.02	1.00	
	% OF EMERGENCY RATING	74.10%	80.50%	52.10%	52.10%	78.90%	78.90%	55.50%	55.50%			



BENCH MARK	CASE DESCRIPTION	FOR GBPP PANDA GILA RIVER AND PALO VERDE GEN PROJECT		FOR GBPP PANDA GILA RIVER AND PALO VERDE GEN PROJECT		FOR GBPP PANDA GILA RIVER AND PALO VERDE GEN PROJECT		FOR GBPP PANDA GILA RIVER AND PALO VERDE GEN PROJECT		PPK 230KV (PU)	KYR 230KV (PU)	COMMENTS
		W/OUT GEN	W/OUT GEN									
2003HS PDE-04	BASE CASE FLOW	1259	1336	1486	1486	1850	1850	1213	1213	1.02	1.00	
	BASE CASE FLOW	(AMP)	(AMP)	(AMP)	(AMP)	(AMP)	(AMP)	(AMP)	(AMP)	1.02	1.00	
	% OF CONTINUOUS RATING	77.50%	77.50%	84.30%	84.30%	84.10%	84.10%	66.10%	66.10%			
ALT A	OUTAGE CASE FLOW	1473	1584	OUT	OUT	2323	2323	1324	1324	1.02	1.00	
	ONE PALO VERDE-WWG OUT	78.00%	86.80%	OUT	OUT	92.10%	92.10%	42.00%	42.00%			
	% OF EMERGENCY RATING											
ALT B	PALO VERDE-ESTRELLA OUT	1449	1548	2043	2043	2453	2453	1321	1321	1.01	0.99	
	% OF EMERGENCY RATING	76.70%	83.60%	63.90%	63.90%	97.30%	97.30%	41.90%	41.90%			
ALT C	JOJOBA-KYRENE OUT	1486	1605	2251	2251	OUT	OUT	1243	1243	1.00	0.97	
	% OF EMERGENCY RATING	78.60%	86.00%	70.30%	70.30%	OUT	OUT	38.50%	38.50%			
ALT D	ONE JOJOB- GILA RIVER OUT	1400	1488	1821	1821	2078	2078	2648	2648	1.02	1.00	
	% OF EMERGENCY RATING	74.10%	80.50%	60.70%	60.70%	82.40%	82.40%	84.01%	84.01%			
PDE-04R	BASE CASE (IN MW)	1257	1333	1483	1483	1793	1793	1143	1143	1.03	1.01	
	BASE CASE FLOW(IN AMP)	(AMP)	(AMP)	(AMP)	(AMP)	(AMP)	(AMP)	(AMP)	(AMP)	1.03	1.01	
	% OF CONTINUOUS RATING	77.20%	77.20%	53.50%	53.50%	80.30%	80.30%	65.00%	65.00%			
ALT D	ONE JOJOB- GILA RIVER OUT	1398	1488	1586	1586	1889	1889	2489	2489	1.03	1.01	
	% OF EMERGENCY RATING	74.00%	80.30%	49.90%	49.90%	79.10%	79.10%	78.00%	78.00%			

TS-TABLE 2

STABILITY IMPACT WITH AND WITHOUT THE GBPP (633 MW) GENERATION PROJECT
(WITH THE PANDA GILA RIVER 500/230 KV TRANSFORMER)

CASE NO.	CASE DESCRIPTION	POWER FLOW (MW)										STABILITY RESULTS				
		SCIT FLOW	EOR FLOW	COI FLOW	GBPP GEN	PANDA GEN	PVNG GEN	PVNG MARG	NEW GEN	PV/NEW TOT	PANDA 500/230	PV500 (P.U.)	MA500 (P.U.)	COMMENTS		
STAB-1	3 PH FLT @ JOJOBA 500KV BUS L/O TWO JOJOBA-GILA RIVER (TRIP PANDA GENERATION OF 1660 MW; 3 UNITS OUT OF TOTAL4)													1.03 3% Dip	0.98 10% Dip	STABLE & DAMPED
STAB-2	L/O TWO PALO VERDE UNITS (TRIP A TOTAL OF 2808 MW GEN)													1.04 2% Dip	0.86 22% Dip	STABLE & DAMPED
STAB-3	3 PH FLT @ PV 500 KV BUS L/O TWO PV-WWG													0.95 11% Dip	0.98 10% Dip	STABLE & DAMPED

CASE NO.	CASE DESCRIPTION	POWER FLOW (MW)										STABILITY RESULTS				
		SCIT FLOW	EOR FLOW	COI FLOW	GBPP GEN	PANDA GEN	PVNG GEN	PVNG MARG	NEW GEN	PV/NEW TOT	PANDA 500/230	PV500 (P.U.)	MA500 (P.U.)	COMMENTS		
STAB-1	NO ADDITIONAL NEW GEN.															
STAB-1	3 PH FLT @ JOJOBA 500KV BUS L/O TWO JOJOBA-GILA RIVER (TRIP PDE=633MW & PANDA=1660 MW; A TOTAL OF 2363 MW GEN)													1.03 3% Dip	0.90 18% Dip	STABLE & DAMPED
STAB-2	L/O TWO PALO VERDE UNITS (TRIP A TOTAL OF 2808 MW GEN)													1.04 2% Dip	0.86 22% Dip	STABLE & DAMPED
STAB-3	3 PH FLT @ PV 500 KV BUS L/O TWO PV-WWG													0.95 11% Dip	0.98 10% Dip	STABLE & DAMPED

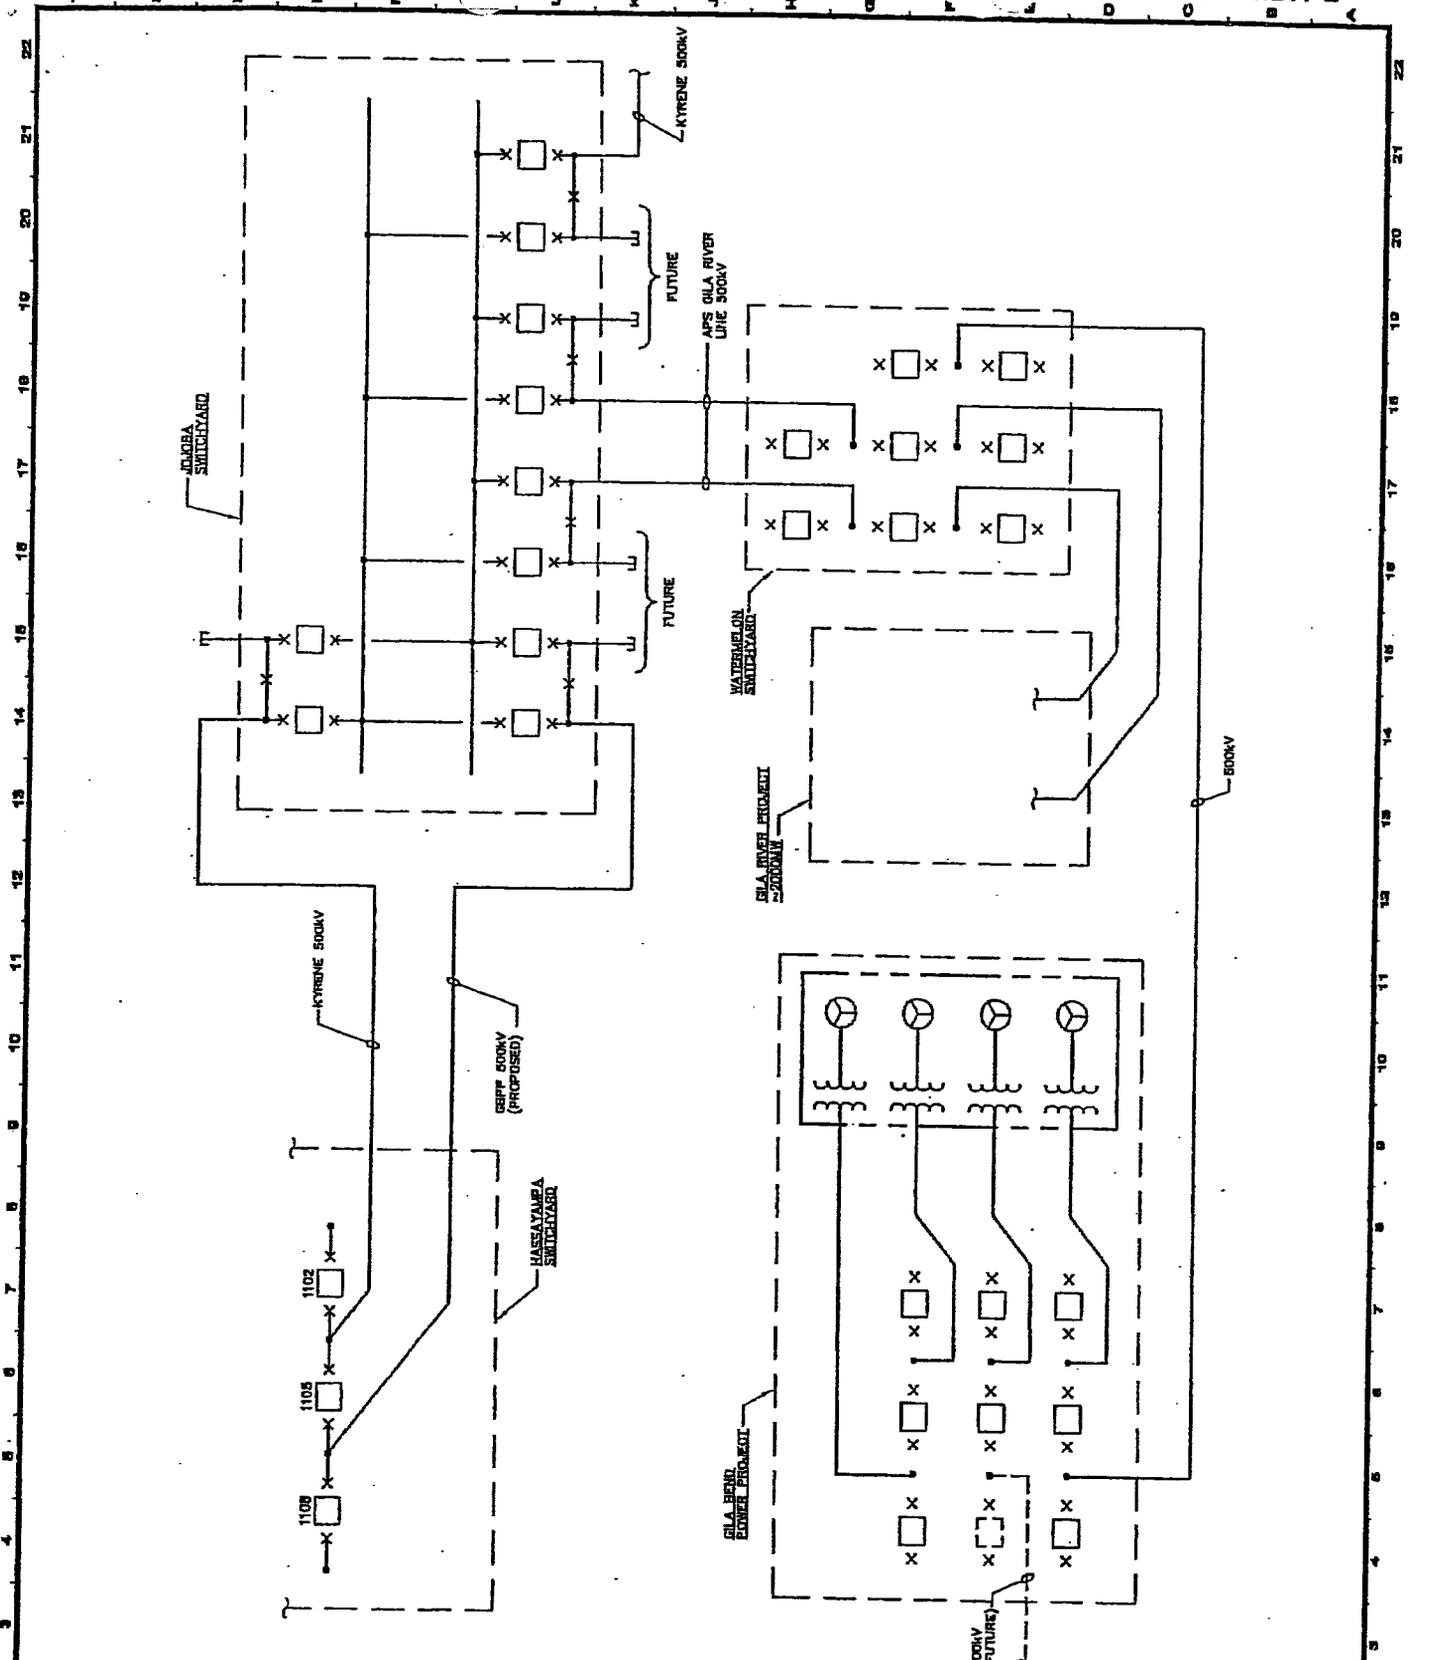


No.	Revisions	Date

GILA BEND
POWER PARTNERS L.L.C.

INTERCONNECTION
DIAGRAM

20080214.mxd
DESIGN DRAWING ENCL
Job Number: 147100
Date: 3/1/03
Sheet Number
Fig 1
1 of 3 sheets

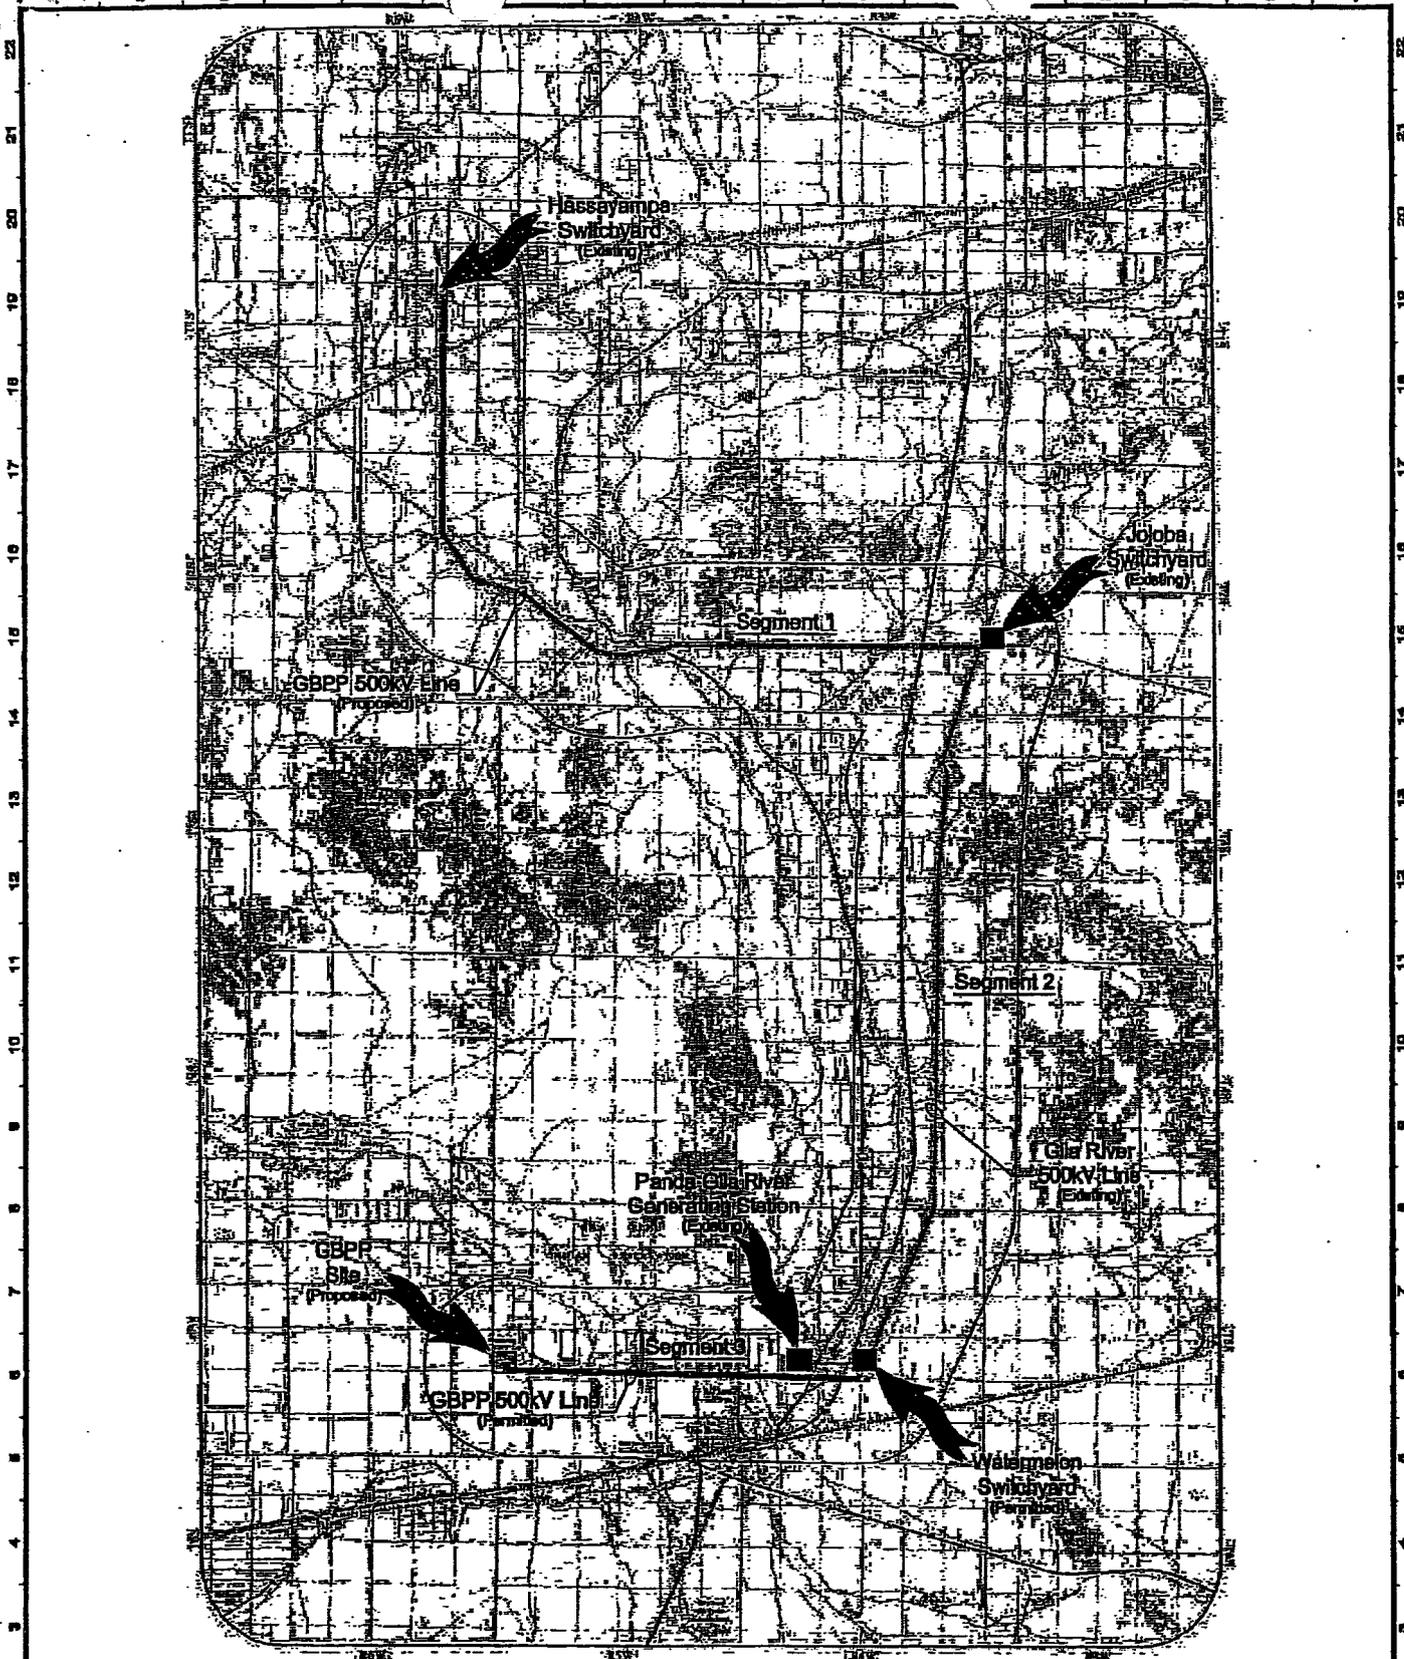

Rev.	Revisions	Date

GILA BEND
POWER PARTNERS L.L.C.

ROUTE
MAP

20030204-14113

DESIGN DRAWING SHEET

Sheet Number: 147180 Date: 2/3/03

Sheet Number

Fig 2

1 of 2 sheets