

SOUTHWESTERN

Power Group II, LLC

RECEIVED
AZ CORP COMMISSION
Docket Control
Energy Company - Alliance Builder



0000150636

2014 JAN 2 PM 12 08

Docket No. E-00000D-13-0002

ORIGINAL


January 2, 2014

Docket Control
Arizona Corporation Commission
1200 West Washington
Phoenix, Arizona 85007

Arizona Corporation Commission

DOCKETED

JAN 02 2014



Subject: Bowie Power Station, L.L.C.
Ten Year Plan for 2014
Decision Nos. 64625, 64626, 69339, 70588 and 71951

To Whom It May Concern:

Pursuant to A.R.S. § 40-360.02 (A) and (C), Bowie Power Station, L.L.C. ("Bowie") hereby submits its Ten Year Plan filing for the year 2014 for the transmission line facilities which are the subject of a Certificate of Environmental Compatibility ("CEC") which was granted by the Commission on March 7, 2002 in Decision No. 64626. This decision was extended through December 31, 2010 by the Arizona Corporation Commission ("Commission") on February 20, 2007 in Decision No. 69339, and further extended through December 31, 2020 by the Commission on November 1, 2010 in Decision No. 71951.


Bowie received approval of the Commission for an amendment to Decision No. 64626 that brought the project's transmission line and Willow Substation placement into compliance with the requirements of the Arizona State Land Department. The nature of this amendment is set forth in Decision No. 70588, dated November 6, 2008. Appendix "A" is a map depicting the approved 345 kV transmission line alignment and Willow Substation location, as documented in Decision No. 70588. As used herein, the phrase "transmission line" includes all facilities contained within the definition of that phrase as set forth in A.R.S. § 40-360.

The information requirements set forth in A.R.S. § 40-360.02 (C) are found in Appendix "B".

Bowie continues its active involvement in regional transmission planning organizations, including WestConnect, the Southwest Area Subregional Transmission Planning Group and the latter's subcommittees. Additionally, through its owner, Southwestern Power Group, Bowie remains an Affiliate Member in good standing in the Western Electricity Coordinating Council.

Please direct any questions that may arise from this report to the undersigned at (602) 808-2004.

Sincerely,



**Tom C. Wray
Manager, Transmission and Generation Projects**

Appendices (2)

Cc: File

**Stephen M. Olea, Utilities Division, Arizona Corporation Commission
Janice Alward, Esq., Legal Division, Arizona Corporation Commission
Kevin Torrey, Esq., Legal Division, Arizona Corporation Commission
David Getts, SouthWestern Power Group
Lawrence V. Robertson, Jr., Esq., Munger & Chadwick, P.A**

Appendix “A”

**345 kV Transmission Line Alignment
Interconnecting Bowie Power Station
to Willow Substation**

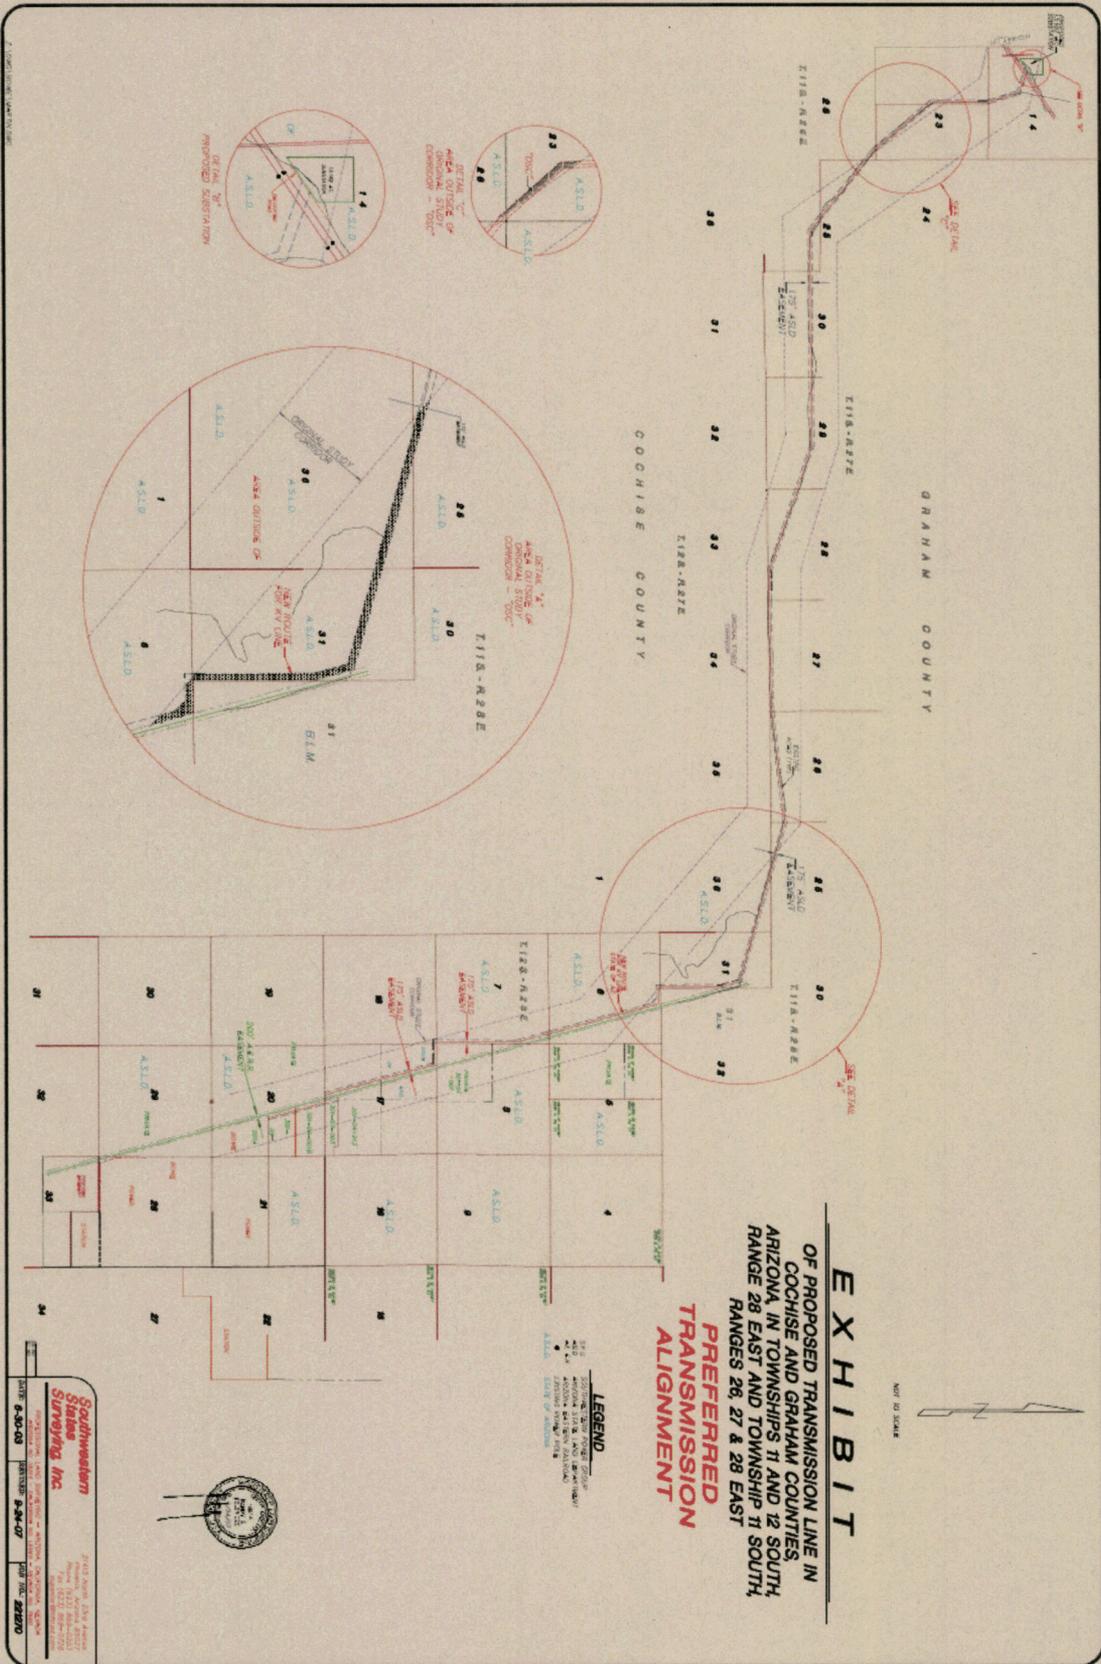


EXHIBIT
OF PROPOSED TRANSMISSION LINE IN
COCHISE AND GRAHAM COUNTIES,
ARIZONA, IN TOWNSHIPS T1 AND T2 SOUTH,
RANGE 28 EAST AND TOWNSHIP T1 SOUTH,
RANGES 26, 27 & 28 EAST
PREFERRED
TRANSMISSION
ALIGNMENT

Southwestern
Surveying Inc.
 2141 N. 15th Ave., Suite 100
 Phoenix, AZ 85016
 Phone: (602) 998-1111
 Fax: (602) 998-1112
 Website: www.southwesternsurveying.com

DATE: 8-30-08 DRAWN: P-34-07 JOB NO.: 22870

Appendix “B”

Bowie Power Station

A.R.S. § 40-360.02 (C) Information Requirements

B-1

Docket No. E-00000D-13-0002

Appendix B

Information Requirements Pursuant to A.R.S. § 40-360.02 (C)

40-360.02 (C) (1).

The size and proposed route of any transmission lines or location of each plant proposed to be constructed.

The location of the power plant as described in the Application and Record of Docket Number L-00000BB-01-0118 (the "Bowie Docket") remains unchanged.

The transmission interconnection of the power plant at Bowie with the underlying grid remains unchanged from that described in the Bowie Docket: an approximately 15-mile, double-circuit 345 kV transmission line from the point of interconnection on the existing Greenlee-Winchester-Vail 345 kV line, that is owned and operated by Tucson Electric Power Company, which is known as the Willow Substation, and thence to the Bowie Plant Switchyard.

Bowie received approval from the Commission for an amendment to Decision No. 64626 that adjusted the alignment of Bowie's interconnecting double-circuit 345 kV transmission line. This amendment brought the project's transmission line placement into compliance with the Arizona State Land Department's requirements. The nature of this amendment is set forth in Decision No. 70588, dated November 6, 2008. See Appendix "A" of this Ten Year filing, for a map depicting the approved 345 kV transmission line alignment documented in Decision No. 70588.

40-360.02 (C) (2).

The purpose to be served by each proposed transmission line or plant.

The purpose to be served by the proposed transmission line and the power plant remains unchanged from that described in the Bowie Docket.

40-360.02 (C) (3).

The estimated date by which each transmission line or plant will be in operation.

The current estimated operation date for the interconnecting transmission line is estimated during 2017.

Current planning anticipates operation of Bowie as follows:

- a. Initial energization of all 345 kV interconnection facilities is estimated to occur by December 31, 2017; and,
- b. Commercial operation of the initial 500 MW (nominal) power block is estimated to occur by December 31, 2018.

40-360.02 (C) (4).

The average and maximum power output measured in megawatts of each plant to be installed.

The average and maximum power output measured in megawatts of the Bowie Power Station that was described in the Bowie Docket remains unchanged.

40-360.02 (C) (5).

The expected capacity factor for each proposed plant.

The expected capacity factor for Bowie Power Station that was described in the Bowie Docket remains unchanged.

40-360.02 (C) (6).

The type of fuel to be used for each proposed plant.

The type of fuel to be used for the Bowie Power Station that was described in the Bowie Docket remains unchanged.

40-360.02 (C) (7).

The plans for any new facilities shall include a power flow and stability analysis report showing the effect on the current Arizona electric transmission system. Transmission owners shall provide the technical reports, analysis or basis for projects that are included for serving customer load growth in their service territories.

SWPG and TEP entered into an Interconnection Facilities Study Agreement on October 12, 2012. The Interconnection Facilities Study will provide a project description, preliminary design and engineering, cost estimate, and schedule for required facilities to interconnect Bowie's Large Generating Facility to TEP's transmission system at the proposed Willow Substation.

TEP provided the Facility Study for the Willow 345 kV Switchyard to SWPG on October 29, 2013. Bowie and TEP are in the process of executing a Large Generator Interconnection Agreement ("LGIA"). The LGIA should be completed by March 2014.

Bowie will file a copy of the Interconnection System Impact Re-Study, Facilities Study and LGIA in Docket No. L-00000BB-01-0118-00000 when the LGIA is completed and fully executed by the parties.